

## Bowling Pin Manufacturer Fights Rising Energy Costs With Premium-Efficiency Motors



Let's face it: making bowling pins isn't something you'd naturally associate with a need for electrical energy efficiency. Bowling has been around for hundreds of years, so the technology to make the pins should be pretty well optimized, right? Well, yes, but there's more to the story than that.

A little background: Bowling as we know it today became popular around the turn of the 20th Century. Interest peaked in the 1960s, when there were more than 12,000 bowling centers in the country. Only about half of them are still in business today, but the sport is rebounding thanks to improved technology in equipment and scoring systems plus the introduction of snazzy entertainment options.

That's just fine with *QubicaAMF*, the industry leader. If only part of that name rings a bell, you're probably familiar with the U.S. half of the company, which began as American Machine and Foundry (AMF) more than 106 years ago. The company eventually became the dominant player in the industry. It continues today as a 50-50 partnership between AMF Bowling Products and Italy-based Qubica Worldwide, supplying virtually everything associated with the sport of bowling, including the lowly, but not entirely low-tech, pins.

### Three Reasons to Cut Energy Use

So, what do bowling pins have to do with energy conservation? Ron Mizzi and Rick Streeter know. They're the plant engineer and purchasing agent, respectively, for the Pins Division at QubicaAMF's plant in Lowville, New York. "Making bowling pins is actually quite energy-intensive," Mizzi explains. "We kiln-dry the wood in-house, which uses a lot of thermal energy; then we plane, rip and assemble boards into glued pre-forms called billets (**Figure 1**). After the glue cures, the billets are turned into pins on special lathes (**Figure 2**), a plastic base is attached,



centage points more efficient than the so-called "EPA motors" that have been sold in the U.S.A. since 1997.<sup>1</sup>

Subsidies under the Energy Smart program range from \$25 for a 1-hp motor to \$480 for a 200-hp model and represent savings of up to about 12% off distributor-discounted prices. Only motors that meet or exceed NEMA Premium efficiency standards qualify for incentives and only companies served by participating utilities are eligible to participate in the program, and then only if the company pays the utility's system benefits charge. No tax monies are involved. Numerous utilities throughout the country — and one or two states — offer similar plans.

### Payback in Less than Three Years

With Blodgett's help, Mizzi and Streeter cherry-picked a few motors that were obvious candidates for replacement. Results were impressive, to say the least.

For example, an old, 100-hp, standard-efficiency motor powered the large blower at the plant's bag house (Figure 3). Operating 5,000 hours per year at 80% of full load, the old 91.2%-efficiency motor consumed 327,095 kWh per year, costing QubicaAMF \$42,522 in energy charges annually. QubicaAMF replaced the motor with a NEMA Premium-rated Toshiba EQP III running at

95.4% efficiency. Purchasing and installing the new motor entailed a premium of \$4,579 after the distributor's discount and a \$325 Energy Smart incentive. Yet, because the premium-efficiency motor saved 14,464 kWh worth \$1,880 annually, it paid for itself in less than 2½ years. Had the incentive not been available, the Toshiba would have taken only two additional months to pay back its purchase price. That's how important premium efficiency can be!

The best part is yet to come: That motor alone will continue to add \$1,880 to the bottom line every year, and that could be a long time. NEMA Premium motors run cooler than standard or Epact models since those motors waste a lot less energy as heat, and it is well known that cool-running motors tend to last longer.

Next in line were the lathe motors (Figure 1) and a standard-efficiency 15-hp blower motor that drove another large air-handling system (Figure 4). This system also operates 5,000 h/y with a motor running at 80% of full power. The old motor was replaced with a NEMA Premium-efficiency Leeson Wattsaver, which saves the company 4,010 kWh and \$521 per year. It paid back its \$882 net installed cost in just a year and eight months. Looked at another way, that payback represents a whopping 90% return on investment!

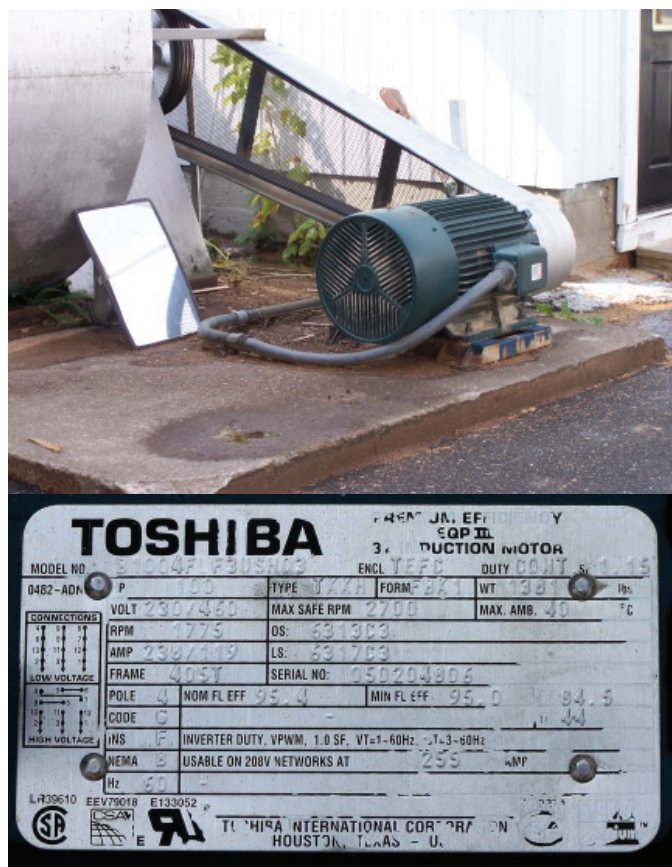


Figure 3. A NEMA Premium-rated 100-hp Toshiba EQP III now powers the large blower (top) at the plant's baghouse. The new motor operates with 95.4% efficiency (dataplate, bottom), saving the company \$1880 annually in energy costs compared with the standard-efficiency motor it replaced. It paid for itself in only 2.43 years.

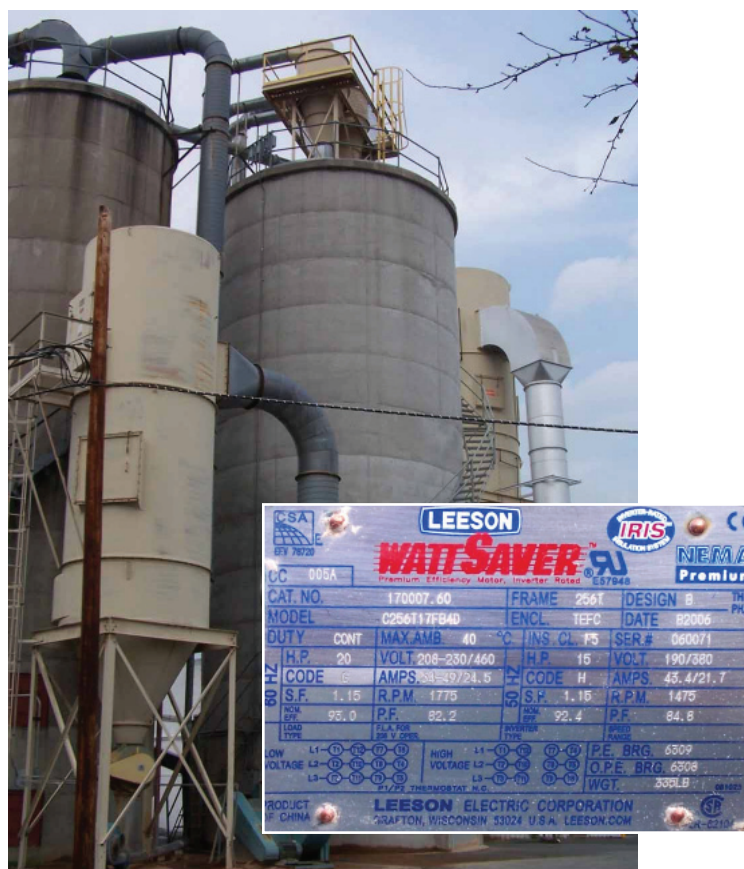


Figure 4. One portion of the extensive air-handling equipment at QubicaAMF's Lowville, New York pin plant. The equipment controls sawdust and collects wood waste, which is burned to produce process heat. The NEMA Premium-rated 15-hp Leeson that now powers the blower (inset) saves the company \$521 annually and paid back its \$882 installed cost in less than two years.

## MotorMaster+ Calculates the Savings

Blodgett brought in one of the resources he utilizes frequently, *Applied Proactive Technologies* (APT), the NYSERDA contractor that administers the authority's Enhanced Commercial Industrial Performance Program (ECIPP) incentives<sup>2</sup>. APT conducted a full motor inventory at the Lowville plant, including the motors' nameplate data, which, along with operating parameters provided by Mizzi and Streeter, was then uploaded into MotorMaster+, a motor-cost evaluation program developed by the U.S. Department of Energy. The program's built-in database contains costs and operating characteristics for hundreds of motors, making comparisons easy. The software is versatile and user-friendly for anyone with a nominal understanding of motor-related energy costs. Readers can download a free copy from the DOE website.

Qubica AMF's accountants insisted new motors should pay for themselves in three years or less, which the NEMA Premium motors obviously did. That's actually pretty generous: Experience shows that high-duty-cycle motors operating in a high-rate area like the Northeast usually pay back their capital investment in less than two years.<sup>3</sup> The higher the duty cycle and load factor, and the higher the utility rate, the faster the payback. In QubicaAMF's case, MotorMaster+ calculated a list of annual savings and projected payback periods for each motor in inventory, providing three choices of replacements having comparable operating characteristics (**Figure 5**). The calculations took into account distributor discounts as well as the Energy \$mart incentive.

So far, Streeter and Mizzi have replaced 21 motors with NEMA Premium models, yielding continuing, annual savings of \$17,850. They've got their sights on additional motors, which they'll upgrade over the coming years. How much can your plant save by replacing inefficent motors? To find out, visit the DOE website at [http://www1.eere.energy.gov/industry/bestpractices/software\\_motor-](http://www1.eere.energy.gov/industry/bestpractices/software_motor-master.html)

[master.html](http://www1.eere.energy.gov/industry/bestpractices/software_motor-master.html) to download a free copy of MotorMaster+ or contact your motor distributor or local utility. We think you'll be pleasantly surprised by the answer.

## The Principals



**Ron Mizzi** is plant engineer for the Pins Division of QubicaAMF, 7412 Utica Boulevard, Lowville, NY 13367-USA. He can be reached at [Mizzi@quibcaamf.us](mailto:Mizzi@quibcaamf.us).



**Rick Streeter** is purchasing agent for QubicaAMF's Pins Division in Lowville. He can be reached at [rstreeter@quibcaamf.us](mailto:rstreeter@quibcaamf.us).



**Terry Blodgett** is manager of the Watertown, New York branch of Kaman Industrial Technologies, a nationwide electrical and industrial equipment distributor. Mr. Blodgett can be reached at 131 Moulton Street, Watertown, NY 13601, (315) 782-1020, and at [wtrap01-kit@kaman.org](mailto:wtrap01-kit@kaman.org).

## Footnotes

<sup>1</sup> As used in this article, the term "premium-efficiency" refers to motors meeting NEMA Premium® efficiencies, conforming to NEMA MG 1-2006, Tables 12-12 and 12-13.

<sup>2</sup> Programs such as ECIPP are known as "Demand- Side Management" (DSM) incentives. The programs seek to reduce both energy waste and the generation of carbon dioxide from power plants. First popularized in the early 1990s and encouraged under the Energy Policy Act of 1992 (EPAct 92), DSM programs typically permit utilities to collect a system benefit charge (a user participation fee) from subscribers, the proceeds from which underwrite incentive programs such as ECIPP. A good description of these programs can be found in a report issued by the Consortium for Energy Efficiency: CEE report: U.S. Energy-Efficiency Programs, a \$2.6 Billion Industry, which is available for download from the CEE website, [www.cee1.org](http://www.cee1.org).

<sup>3</sup> See <http://www.copper.org/energy>

Batch Parameters														
Scenario: Replace Existing Load Est Method: kWCalc Default Load: 80%										Payback: <= 3 yrs Peak months: 12 AutoDownsize: No				
ID	Description	Manufacturer/Model	Catalog	Price	Disc.	Install	Rebate	HP	Energy		Demand		Total Savings	Payback
									kWh	kWh\$	kW	kW\$		
36	#5 Kiln #2 Fan 5 HP, 1200 RPM ODP, 460 volts	Toshiba Premium Efficient ODP		355	42	70	30	5	1839	\$239	0.3	\$0	\$239	1.6 yrs
		Reliance P21S3042	P21S3042	350	42	70	0	5	1747	\$227	0.3	\$0	\$227	1.8 yrs
		Baldor SUPER-E, NEMA	EM3309T	440	42	70	30	5	1954	\$254	0.3	\$0	\$254	1.9 yrs
37	#5 Kiln #3 Fan 5 HP, 1200 RPM ODP, 460 volts	Toshiba Premium Efficient ODP		355	42	70	30	5	1839	\$239	0.3	\$0	\$239	1.6 yrs
		Reliance P21S3042	P21S3042	350	42	70	0	5	1747	\$227	0.3	\$0	\$227	1.8 yrs
		Baldor SUPER-E, NEMA	EM3309T	440	42	70	30	5	1954	\$254	0.3	\$0	\$254	1.9 yrs
38	#5 Kiln #4 Fan 5 HP, 1200 RPM ODP, 460 volts	Toshiba Premium Efficient ODP		355	42	70	30	5	1839	\$239	0.3	\$0	\$239	1.6 yrs
		Reliance P21S3042	P21S3042	350	42	70	0	5	1747	\$227	0.3	\$0	\$227	1.8 yrs
		Baldor SUPER-E, NEMA	EM3309T	440	42	70	30	5	1954	\$254	0.3	\$0	\$254	1.9 yrs
39	#5 Kiln #5 Fan 5 HP, 1200 RPM ODP, 460 volts	Toshiba Premium Efficient ODP		355	42	70	30	5	1839	\$239	0.3	\$0	\$239	1.6 yrs
		Reliance P21S3042	P21S3042	350	42	70	0	5	1747	\$227	0.3	\$0	\$227	1.8 yrs
		Baldor SUPER-E, NEMA	EM3309T	440	42	70	30	5	1954	\$254	0.3	\$0	\$254	1.9 yrs
40	#5 Kiln #6 Fan 5 HP, 1200 RPM ODP, 460 volts	Toshiba Premium Efficient ODP		355	42	70	30	5	1839	\$239	0.3	\$0	\$239	1.6 yrs
		Reliance P21S3042	P21S3042	350	42	70	0	5	1747	\$227	0.3	\$0	\$227	1.8 yrs
		Baldor SUPER-E, NEMA	EM3309T	440	42	70	30	5	1954	\$254	0.3	\$0	\$254	1.9 yrs
41	#3 Kiln #7 Fan 5 HP, 1200 RPM ODP, 460 volts	Toshiba Premium Efficient ODP		355	42	70	30	5	1839	\$239	0.3	\$0	\$239	1.6 yrs
		Reliance P21S3042	P21S3042	350	42	70	0	5	1747	\$227	0.3	\$0	\$227	1.8 yrs
		Baldor SUPER-E, NEMA	EM3309T	440	42	70	30	5	1954	\$254	0.3	\$0	\$254	1.9 yrs
42	#1 Condensate Pump 1 HP, 3600 RPM TEFC, 460 volts	WEG Electric Motors NEMA		140	42	50	25	1	461	\$60	0.1	\$0	\$60	2.8 yrs

Figure 5. A small portion of the batch motor analysis performed for QubicaAMF by Applied Proactive Technologies using MotorMaster+. The numbers in the far-left column refer to a few of the plant's 232 operating motors. The DOE software projected total annual savings of \$17,850 for the motors the company chose to replace with NEMA Premium-rated models.

This publication has been prepared solely as resource material for the use of individuals involved in the specification, design, selection and installation of electrical systems. It has been compiled from information provided by one or more of the parties mentioned herein and other information sources Copper Development Association Inc. (CDA) and/or the relevant parties believe to be competent. However, recognizing that each system must be designed and installed to meet particular circumstances, CDA and the parties mentioned in this publication assume no responsibility or liability of any kind, including direct or indirect damages in connection with this publication or its use by any person or organization, AND MAKE NO REPRESENTATIONS OR WARRANTIES OF ANY KIND RELATED TO ITS USE, ACCURACY, COMPLETENESS, UTILITY, AVAILABILITY OR DOCUMENTATION.