



Market Evaluation for Energy Storage in the United States



Prepared for the Copper Development Association, Inc. (CDA)



Copyright © 2012, KEMA, Inc.

This document, and the information contained herein, is the exclusive, confidential and proprietary property of KEMA, Inc. and is protected under the trade secret and copyright laws of the U.S. and other international laws, treaties and conventions. No part of this work may be disclosed to any third party or used, reproduced or transmitted in any form or by any means, electronic or mechanical, including photocopying and recording, or by any information storage or retrieval system, without first receiving the express written permission of KEMA, Inc. Except as otherwise noted, all trademarks appearing herein are proprietary to KEMA, Inc.

Table of Contents

1. Executive Summary	1-1
2. Introduction	2-1
2.1 Energy Storage Technologies	2-1
2.2 Energy Storage Grid Applications	2-4
3. Methodology	3-1
3.1 Market Penetration Model Summary	3-2
3.2 Costs and Payback Periods	3-3
3.3 Copper Intensity	3-4
4. Relevant Initiatives in Energy Storage	4-1
5. Results of Market Penetration Study	5-1
5.1 Market Summary	5-1
5.2 Market Drivers & Trends.....	5-6
5.3 Market Potential Conclusions	5-7
6. Results of Copper Demand Analysis	6-1
6.1 Copper Demand Summary	6-1
6.2 Storage Unit Copper Intensities.....	6-3
6.3 Copper Intensities of Installed Storage Applications	6-4
6.4 Copper Intensity of Associated Industries	6-5
7. Conclusions and Recommendations	7-1
Appendix A. Survey	A-1
Appendix B. Grid-connected Storage Applications.....	B-1
Appendix C. Detail on Battery Energy Storage Systems	C-1
Appendix D. References	D-1

Table of Contents

List of Figures

Figure 1. Benefits of Energy Storage along the Electricity Value Chain	2-1
Figure 2. Storage Ratings by Technology Type.....	2-2
Figure 3. Storage Capital Costs by Technology Type	2-3
Figure 4. Storage Efficiency and Lifetime by Technology Type.....	2-4
Figure 5. High Potential Storage Applications	2-5
Figure 6. Grid Energy Storage Summary.....	2-6
Figure 7. U.S. Energy Storage Market Penetration Methodology Overview	3-1
Figure 8. KEMA Market Penetration Model Dashboard.....	3-3
Figure 9. Storage Installation Methodology	3-6
Figure 10. DOE Smart Grid Demonstration Grants	4-1
Figure 11. Policy Initiatives Shaping the U.S. Energy Storage Market	4-2
Figure 12. U.S. Application Market Development Horizon.....	4-4
Figure 13. Estimated Current Installed Capacity by Technology (MW)	5-1
Figure 14. Estimated Current Installed Capacity by Application (MW)	5-2
Figure 15. Estimated Five-year Incremental Growth, by Application, with No Credit.....	5-2
Figure 16. Estimated Five-year Incremental Installed Capacity by Technology, No Credit	5-3
Figure 17. Estimated Five-year Incremental Installed Capacity by Financial Incentive Scenario.....	5-4
Figure 18. Estimated Five-year Total Installed Capacity by Application (MW), No Incentive	5-5
Figure 19. Estimated Five-year Installed Capacity by Technology (MW), No Incentive	5-5
Figure 20. Renewables Integration Copper Demand.....	6-1
Figure 21. Ancillary Services Market Copper Demand	6-1
Figure 22. Transmission Services Copper Demand	6-2
Figure 23. Other Distributed Storage Copper Demand.....	6-2
Figure 24. CES Copper Demand	6-3
Figure 25. Storage Unit Copper Intensities.....	6-4
Figure 26. Copper Intensity of Storage Installations	6-5
Figure 27. Flexibility Supply Curve	6-6

Abbreviations

AB	assembly bill
BMS	battery management system
CAES	compressed air energy storage
CAISO	California ISO
CES	community energy storage
DC	direct current
DOE	U.S. Department of Energy
ERCOT	Electric Reliability Council of Texas
ESA	Electricity Storage Association
FERC	Federal Energy Regulatory Commission
GW	gigawatt
HVAC	heating, ventilating, and air conditioning
ISO	independent system operator
ISO-NE	ISO of New England
kV	kilovolt
kVA	kilovolt-ampere
KW	kilowatt
KWh	kilowatt-hour
Li	lithium
MISO	Midwest ISO
MW	megawatt
MWh	megawatt hour
NaS	sodium sulfur
Ni-Cd	nickel cadmium
NYISO	New York ISO
PJM	PJM Interconnection
PV	photovoltaic solar
R&D	research and development
RPS	renewable portfolio standard
RTO	regional transmission organization
SPP	Southwest Power Pool
TOU	time of use
T&D	transmission and distribution
V	volt

1. Executive Summary

Project Summary

Commissioned by the Copper Development Association Inc. (CDA), this paper evaluates the near-term market for grid energy storage in the United States (U.S.) and the copper content associated with this market. The CDA is the market development, engineering, and information services arm of the copper industry, chartered to enhance and expand markets for copper and its alloys in North America. To support the CDA with its objectives for an energy storage market assessment, KEMA focused on four core points of analysis:

1. Defining the current market for energy storage in the U.S.
2. Assessing initiatives that are shaping the U.S. energy storage market
3. Forecasting the near-future U.S. market for energy storage from 2011 to 2016
4. Projecting copper demand associated with the U.S. energy storage market

To forecast an annual market size of grid storage in the U.S., KEMA used its energy storage market penetration model. The analysis incorporated information on current and planned U.S. grid-storage activities, known grid-storage market trends, and proposed energy-storage incentives. KEMA supplemented analysis of the current market and five-year market potential with information on longer term market drivers to provide further insight into the U.S. market potential. The study considers technologies including electrochemical, mechanical and thermal storage, and grid applications ranging from distributed community energy storage (CES) to centralized, bulk storage. The study focuses on the four applications of ancillary services, transmission services, community energy storage, and other distributed storage.

To estimate the copper demand associated with the U.S. energy storage market, KEMA developed estimates of storage-device copper content based on its knowledge of storage materials and on input from storage developers. KEMA also estimated the storage intensity of storage installations, which it paired with the storage market forecasts to estimate market-wide copper demands.

Methodology

The market for energy storage in the U.S. is a rapidly changing one, with new technologies being developed and new applications being investigated on regular basis. In the midst of this evolution, however, a number of common applications and technologies have arisen. To create a snapshot that is representative of the U.S. grid energy storage market, KEMA's analysis focuses on these predominant applications and technologies positioned for near-term growth. As such, the first step of the analysis was to identify the predominant storage applications and pair them with the predominant technologies to identify technology/application bundles that represent the market. Current activities around copper-intensive technologies and applications are also examined and summarized in this step.

After identifying energy storage bundles, KEMA researched current and planned installations by bundle. To develop estimates of future growth, KEMA combined information on current activities and investments with its payback-based technology penetration model. The model leverages energy technology adoption "S-curves" developed based on KEMA's experience with and insights on renewable and energy storage technologies; energy and utility market dynamics; and energy end-use market trends, dynamics, and forecasting. To account for the potential influence of financial policy, KEMA defined two scenarios: one that implements a tax incentive based on the latest proposal made by members of the U.S. Congress¹ and one with no financial incentive.

With the storage market assessment underway, KEMA estimated the associated copper demand for storage in two stages. In the first stage, KEMA identified the copper intensities of energy storage units for each technology type represented in the market model. KEMA based these estimates on published research and interviews with product developers. In the second stage, KEMA estimated the copper intensities of the energy storage units as installed in their associated applications. For these estimates, KEMA included assumptions about the equipment that would be needed to operate the storage device and about the copper content of such equipment. With many storage applications in the demonstration phase, energy storage installations have yet to conform to standard configurations. However, to develop estimates of the order of magnitude of copper for installed applications of energy storage, KEMA developed representative configurations and derived copper intensity ranges.

¹ The U.S. STORAGE Act of 2011 (S.1845), introduced in November 2011, would provide tax incentives for grid storage as well as for on-site and residential applications.

Summary of Results

Based on the U.S. energy storage market assessment and analysis of the copper intensities of storage device and their installations, this research finds that the U.S. market for grid energy storage could result in a sizeable demand for copper. In particular, the copper intensity of storage installations appears to be significant though varied, ranging from zero to over four tons per megawatt (MW), depending on the installation configuration, type of electrical equipment, and storage type.² The total incremental copper demand associated with U.S. grid energy storage is estimated to range from roughly 900 tons of copper to over 3,000 tons of copper. Additional findings from this research are noted below, by topic area.

Copper Demand by Market Segment. Applications for renewable energy integration and ancillary services appear to have the largest near-term associated demand for copper, with additional copper intensive applications, such as CES poised for strong growth.

- Renewable energy integration applications for energy storage appear to have a strong associated demand for copper. Because of the timelines of pumped hydropower investment, lithium-ion, compressed air energy storage (CAES), and lead acid storage are the largest contributors for this market. Estimates for the cumulative associated copper demand range from more than 650 tons to almost 2,200 tons, depending on the existence of financial incentives. The associated incremental copper demand ranges from over 300 tons to over 1,800 tons.
- Energy storage for ancillary services also appears to have a strong associated demand for copper, due to its relatively high copper intensities and relatively high expectations for near-term growth. Estimates for the cumulative associated copper demand range from more than 630 tons to almost 840 tons, depending on the existence of financial incentives. The associated incremental copper demand ranges from over 520 tons to over 720 tons.
- Though the market for distributed thermal storage is relatively large, the copper intensity is relatively limited, limiting the overall associated copper demand of this segment. Other types of distributed energy storage have higher copper intensities, but will likely have limited market penetration over the next five years. Estimates for the cumulative associated copper demand range from more than 100 tons to 160 tons, depending on

² The results of the low and high scenarios KEMA analyzed, which vary the copper intensities of associated equipment, range from 0 to 8 tons of copper per MW.

the existence of financial incentives. The associated incremental copper demand ranges from over 50 tons to over 100 tons.

- The market for transmission-related storage applications is potentially limited in the near term, though the copper intensities for these applications can be relatively strong. Estimates for the cumulative associated copper demand range from more than 85 tons to more than 250 tons, depending on the existence of financial incentives. The associated incremental copper demand ranges from over 5 tons to over 170 tons.
- CES also appears to have a limited associated demand for copper in the near term, due to expectations of limited market growth over the next five years. However, because of its strong copper intensity and potential for large mid- to long-term growth, this area could have strong associated copper demand over time. Estimates of the cumulative associated copper demand range from 30 tons to almost 370 tons, depending on the existence of financial incentives. The associated incremental copper demand ranges from over 20 tons to over 360 tons.

Copper Demand by Application. The demand for copper associated with the U.S. energy storage markets noted earlier comes from not only the copper content of the storage units themselves but also from the electrical equipment needed to operate the energy storage with the grid.

- The copper content of grid energy storage installations appears to be significant, ranging from zero to over four tons per MW.
 - On a per MW basis, CES installations are estimated to have the largest associated copper intensity, with a mid-range estimate of over four tons per MW.
 - Other distributed storage could offer high copper intensity, but the majority of these installations, such as thermal energy storage, offer the lowest copper intensity at 0.04 tons per MW.
 - Applications for renewable energy integration, ancillary services, and transmission services can range from 0.3 to 3 tons per MW.
- Copper intensities can vary significantly by installation and storage technology.³

³ To develop estimates of the order of magnitude of copper for installed applications of energy storage, KEMA estimated representative configurations based on current market trends and derived copper intensity ranges.

-
- With many storage applications in the demonstration phase, energy storage installations have yet to conform to standard configurations.
 - Distributed applications, however, generally have higher copper intensities because they use more lower-voltage equipment, which typically has higher copper intensity. Lower voltage components are more likely to use copper due its higher conductivity and lower maintenance requirements.

Copper Demand by Energy Storage Type. At the unit level, energy storage devices range from zero to nearly 0.3 tons of copper per MW.

- Copper can play a role in the fundamental design of storage units by contributing toward internal connections and current collectors in battery technologies or motors for pumped storage or CAES devices.
- Lithium-ion, flow, and sodium batteries as well as flywheels, CAES, and pumped hydropower are strong users of copper at the unit level, ranging from over 0.10 to nearly 0.3 tons per MW
- Thermal storage, lead-acid batteries, and super capacitors exhibit the lowest copper intensities, ranging from 0 to 0.03 tons per MW.

The U.S. Energy Storage Market. Overall, opportunity abounds as the market is strong and robust, and has large potential. However, the market is still developing with technology and policy still evolving. The market needs to continue with initiatives to reduce costs and increase experience in order for growth to meet expectations. KEMA estimates that over the next five years, the U.S. grid storage market could grow to between two to four gigawatts (GW), depending on the existence of financial incentives.

- Many new technologies are under development and a handful is ready for commercialization.
 - Mature energy storage technologies currently constitute the majority of the energy storage market today. These include thermal energy storage, pumped hydropower, and CAES.^{4,5}

⁴ While 16,000-20,000 MW of pumped hydro capacity are currently installed in the U.S., only a fraction of it is used for applications similar to other storage technologies (i.e., renewables and ancillary services).

-
- In the near term, battery technologies and thermal storage are expected to have the strongest growth areas.
 - Second generation technologies are emerging and research is continuing to be fruitful.
 - Venture capital investment is booming both inside and outside of the U.S.
 - The ability to scale quickly is seen as a challenge, as is the ability to bring down costs.
 - Financial incentives could have a large impact on market size in the next five years by defraying initial investment costs and helping to grow the market.
 - The U.S. markets around grid-storage applications are still evolving.
 - Policy developments are continuing to shape the development of markets around grid applications, and demonstrations are continuing to define grid application success and inform technology value propositions.
 - Markets around some of the grid storage applications are expanding now, such as ancillary services, and markets for other applications that are developing now, such as peaker plant applications, will likely come to fruition after five years.
 - In the next five years, costs are expected to come down (via improved system integration, increased production, and enhanced distribution capability), investments are expected to continue, and areas currently in the demonstration phase will likely start to commercialize.

Copper and Other Industries Associated with Energy Storage. Because of its potential role in supporting the integration of renewable energy, energy storage may also help bolster the copper demand associated with renewable generation.


- Energy storage is one of many tools available to help address renewable intermittency.
- Energy storage can also assist in the integration of renewable energy by helping to address transmission constraints.
- The estimated copper intensities of typical wind farms and typical centralized solar plants, according to prior CDA studies, are three to six tons per MW and two to five tons per MW, respectively.

⁵ Though CAES makes up a significant share of the total installed capacity, there are a limited number of applications in the market today.

2. Introduction

Energy storage technology holds the promise to provide many benefits across the energy delivery value chain—from generation to transmission and distribution (T&D) to end-users. (See Figure 1 for an illustration). Specifically, energy storage technology is considered a key component for integration of high levels of renewable energy penetration and as an essential tool for smart, future electricity grids. In addition, a number of societal benefits, such as reducing emissions, serving as an alternative to a traditional generation plant, or acting as a tool for demand response, can be captured with the deployment of storage technologies.

Figure 1. Benefits of Energy Storage along the Electricity Value Chain

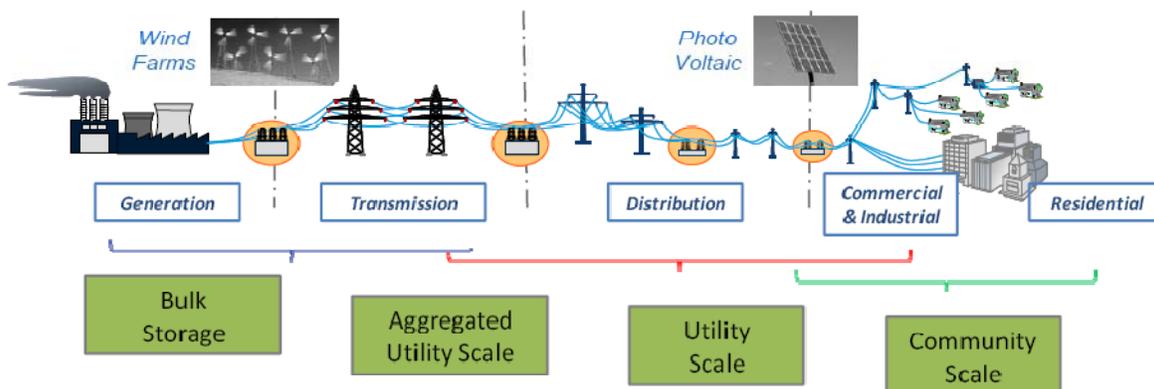

Energy storage has been a part of our electric energy system for decades. Pumped-hydro, for example, is a well-known technology with mature applications installed globally. The concept of CAES has also been known for many years, as has the use of lead-acid batteries in power systems applications. Newer energy storage technologies now in the early market adoption stages, such as lithium-ion batteries, flow batteries, flywheels, and sodium-sulfur battery (NaS) systems, offer improved operational flexibility, improved charge/discharge cycle life, and in some cases longer duration or fast response capabilities.


The following subsections outline information about energy storage technologies and the types of services, or applications, they can provide.

2.1 Energy Storage Technologies

The term energy storage refers to a number of different types of storage technologies, including those whose primary methods are electrochemical, mechanical, or thermal. Within these technology types, several flavors of storage products exist today or are under development.

The different types of products and technologies carry with them performance characteristics and costs that make them more or less suitable for given applications. For example, some applications may emphasize fast response over duration, while others require longer durations. As such, no technology fits all applications. Figure 2 characterizes storage technology types according to two characteristics commonly used to differentiate technologies: rated power and discharge duration. Together, they describe how much power a storage unit can provide (in MW) and for how long (in hours). Overall, there is a great deal of overlap in technology ratings, and even within a given technology type, the range of ratings can be large. The specific products ultimately determine the storage characteristics by unit and are often tailored to the applications for which they are designed.

Figure 2. Storage Ratings by Technology Type

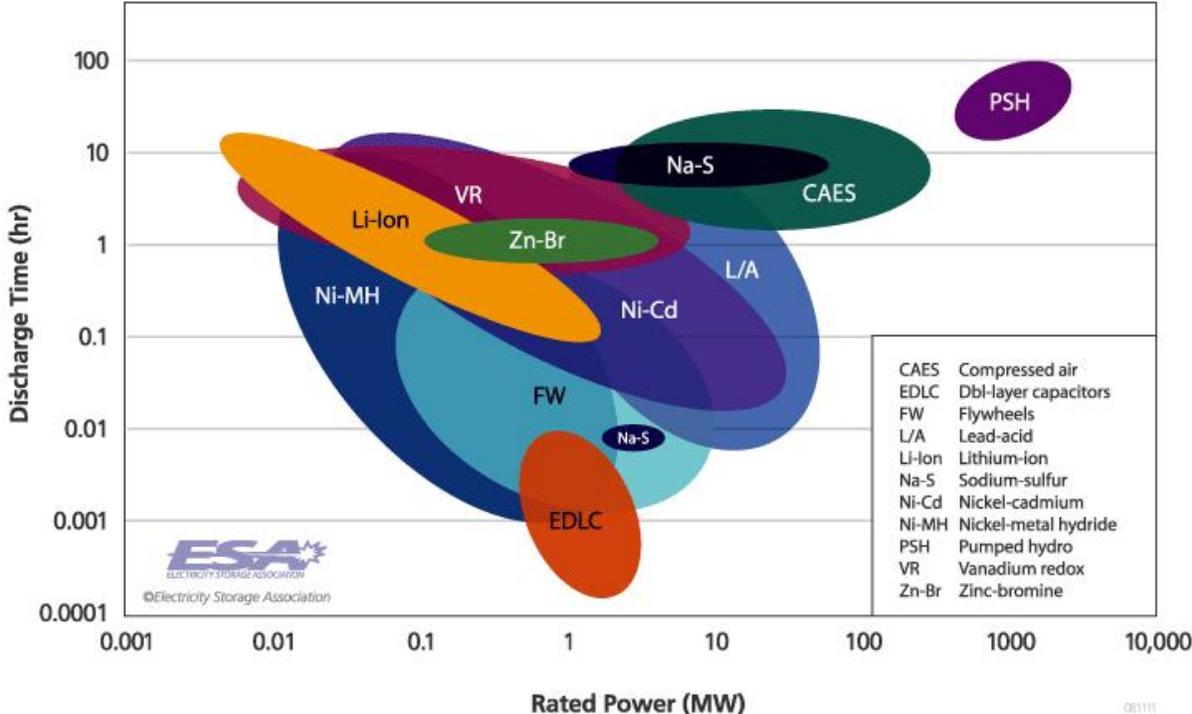


*Based on installed systems, as of November 2008.
 Source: Electricity Storage Association.

Figure 3 depicts storage technologies according to their capital costs, power rating, and energy rating, in dollars per kilowatt (\$/kW) and dollars per kilowatt-hour (\$/kWh), respectively. Apart from performance characteristics, capital and operating costs also determine whether a technology is viable for a given applications. For example, though a product might be suited

technically for a given application, the cost of the product might not justify its costs. Ultimately, the answer to which storage device is best for a given application depends on its technical capabilities as well as the financial viability of the product, based on product costs and application revenues.

Figure 3. Storage Capital Costs by Technology Type

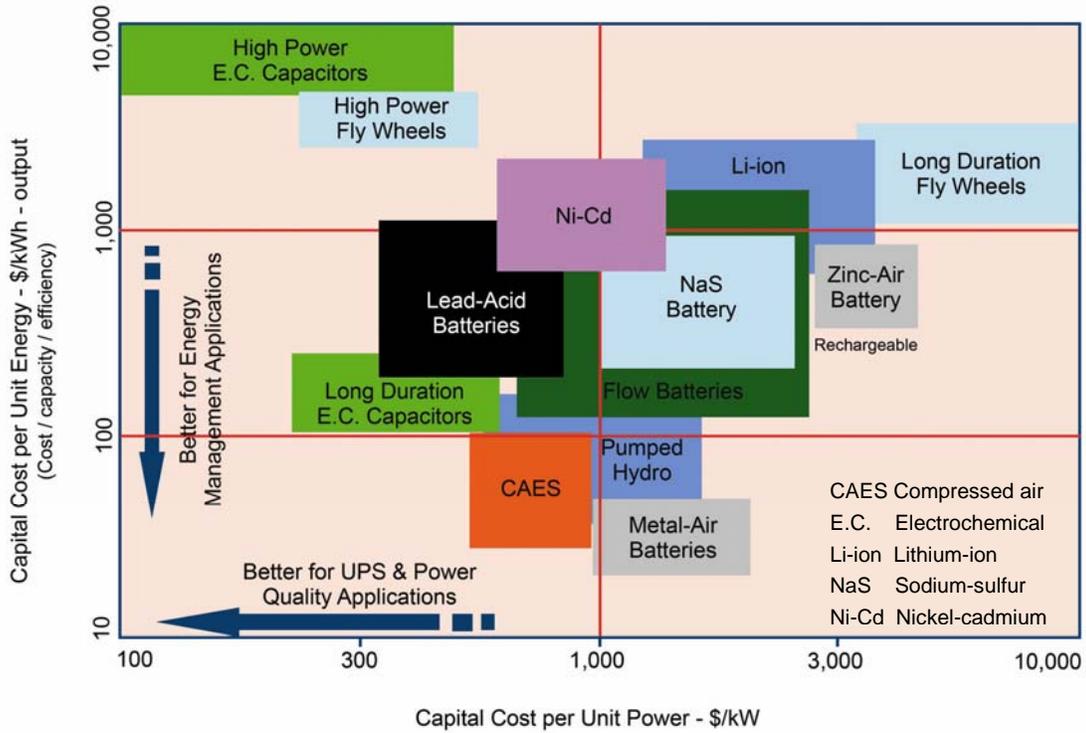


Source: Electricity Storage Association.

Two additional factors that can affect the lifetime costs of an energy storage device, which are also used commonly to describe storage features, are efficiency and cycle life. Cycle life refers to the number of charge and discharge cycles that a storage device can provide before performance decreases so as to make it no longer capable of suitably performing the functions it needs to in an application.

Figure 4 illustrates the efficiency and lifetime of energy storage technologies.

Figure 4. Storage Efficiency and Lifetime by Technology Type

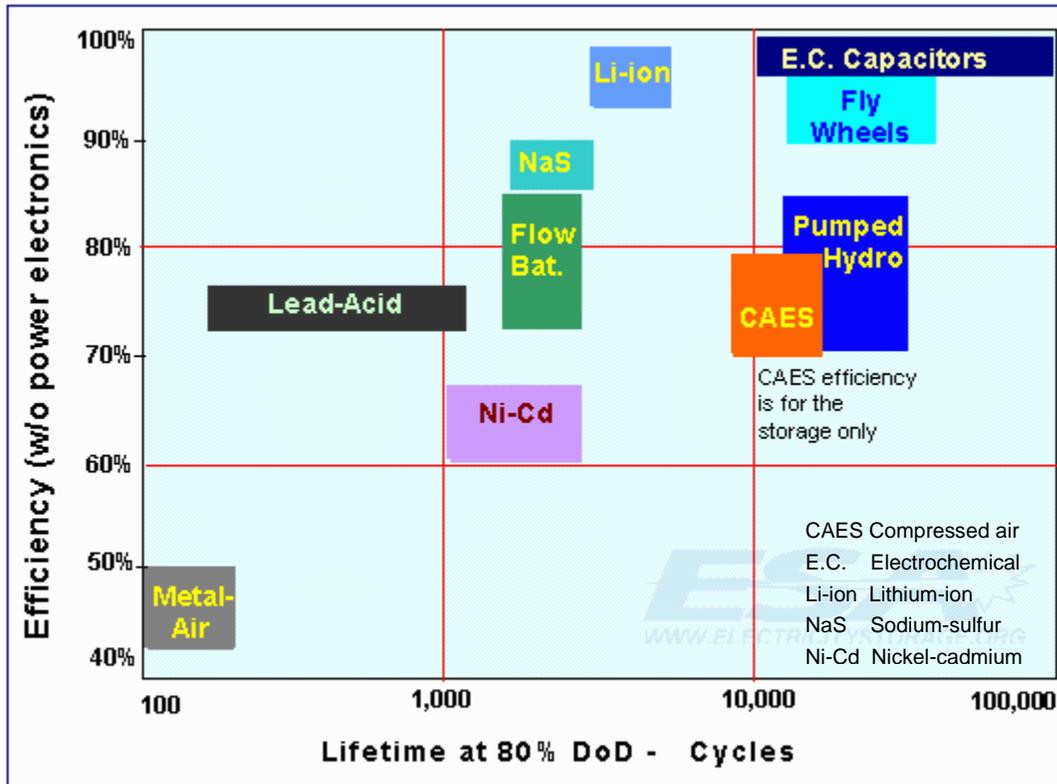

Source: Electricity Storage Association.

2.2 Energy Storage Grid Applications

Energy storage has the ability to serve multiple grid services. A 2010 report by Sandia National Laboratories, for example, identifies 19 different energy storage grid services (see Appendix B for the list and descriptions). These grid services have specific requirements, such as duration and response times, which determine for which technologies they are best suited. In addition, under current energy storage costs and energy market policies and regulations, it can be difficult to justify the cost of an energy storage device for a single application. As such, it is

possible that products would combine several applications, which have both technical and business compatibility, to help make energy storage investments economically more feasible.⁶

The potential markets for many of these applications are large. Figure 5 illustrates the range of estimates for *maximum* market potential by application.

Figure 5. High Potential Storage Applications

High Potential Application Markets <i>(Maximum potential, not forecasted value)</i>	
Load shifting	50 – 85 GW
TOU* energy cost management	30 – 64 GW
Load following	20 – 37 GW
Transmission congestion relief	20 – 37 GW
Renewable time shift	20 – 37 GW
Renewable capacity firming	20 – 37 GW
Demand charge management	20 – 32 GW
Wind integration: long duration	14 – 18 GW
Electric energy time shift	10 – 18 GW
Electric supply capacity	10 – 18 GW
T&D deferral	15 – 20 GW
Frequency regulation	3 – 12 GW

*TOU refers to time of use electricity rates


Application market potential is based on a sampling of industry analyses, including those from Sandia National Laboratories and the Electric Power Research Institute

As the name implies, grid storage is connected at various locations along the electric grid system—ranging from distributed energy storage at the community scale on the order of kilowatts (kW) in capacity, to large-scale battery energy storage on the order of 1–2 MWs often

⁶ The benefits of combined applications cannot be calculated as the straight sum of the individual applications, as one of the services provided by a unit might constrain the ability to provide other services on that unit.

aggregated up to 50 MW in size, and to bulk grid storage on the order of tens of MWs. Figure 6 summarizes the different categories of grid energy storage.

Figure 6. Grid Energy Storage Summary

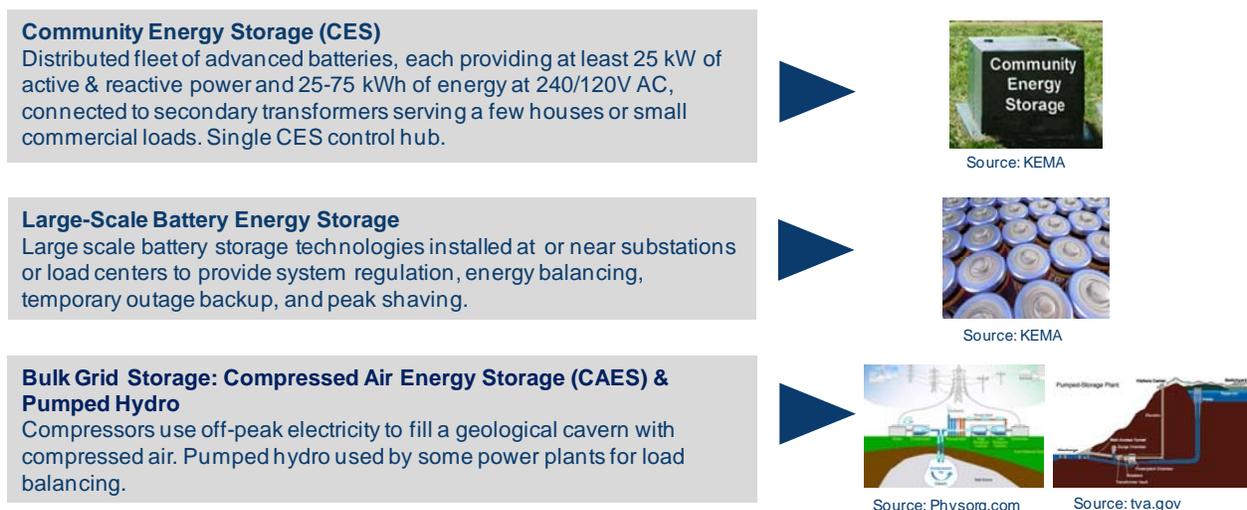

The applications analyzed by KEMA in this study include those which KEMA believes have the largest near-term market growth. These include CES, ancillary services, transmission services, renewables energy integration, and other distributed storage. The following provides a brief description of each.

CES Application—CES is a small, distributed energy storage unit connected to secondary transformers serving a few houses or small commercial loads. As the name implies, local communities are the primary beneficiaries of an energy storage device—CES enhances reliability, reduces the required capital investment by flattening peak loads, compensates for the variability of distributed renewable resources, such as roof top solar photovoltaics (PV), and provides a source of back-up power during grid events for residential and commercial and industrial customers. As such, it combines multiple applications to serve grid needs at the end of the distribution system.

Ancillary Services—Ancillary services are tools used by grid operators to help maintain a continued balance between electricity production and demand.⁷ Studies, such as KEMA’s “The Benefits of Fast Response Storage Device for System Regulation in ISO Markets,” have shown that fast-response storage devices have the ability to provide frequency regulation and spinning

⁷ FERC defines six categories of ancillary services in FERC Order No. 888, 175 FERC ¶ 61,080 (1996).

reserve grid services, a subset of the full set of ancillary services. Independent system operators and regional transmission organizations (ISOs/RTOs) are currently examining the potential for fast-response storage devices to act as an alternative to traditional generation technologies to help balance system supply and demand through regulation and spinning reserves services. In addition, increased implementation of variable renewable generation resources—especially wind and solar—may increase grid volatility, requiring an increased need for frequency regulation services. Advanced energy storage technologies with fast-response capabilities show promise as a potential solution to addressing the volatility introduced by renewables.

Renewable Energy Integration—The renewable energy integration application is directly linked to intermittent renewable implementation on the grid (e.g., wind and solar) and the amount that occurs on a percentage basis. Energy storage can address three “buffering” challenges that variable energy resources introduce on the grid system:

1. Capacity firming—as previously discussed under ancillary service/regulation
2. Smoothing or ramp control—a function to help reduce the adverse impacts of a very fast change in renewable generation level or output
3. Time-shifting—to match typically off-peak renewable energy supply with on-peak demand

Some of the services provided in the ancillary services market will help with the integration of renewable resources. However, it remains to be seen whether the intermittency of renewable resources will be addressed in the markets or outside of them. For example, today, obligations to firm wind capacity—that is to maintain the power output at a committed level for a reasonable time—vary by region. For the most part, the obligation lies with the ISO/RTO. However, there has been movement toward requiring generators of intermittent or variable energy resources to firm their power to minimum requirements before placing their power on the grid. Separately, needs such as management of localized voltage issues could potentially still be addressed by energy storage outside of market-based services.

Transmission Services—Transmission services include primarily the deferral of transmission and distribution equipment, or “T&D deferral,” transmission congestion, and transmission support. T&D deferral is the use of storage to defer the installation or upgrade of transmission and distribution equipment, which can often be difficult to site. Transmission support refers to the use of storage to address electrical anomalies and disturbances on the grid. Transmission congestion relief refers to the use of storage to avoid the need to transmit power during periods

of high system demand. For example, energy stored by devices could be used during on-peak hours when the transmission systems are congested.


Other Distributed Storage—Additional distributed grid storage applications beside CES are under development. For example, thermal storage currently constitutes a large portion of the storage market today. Here, storage can be used to help shift cooling or heating loads to off-peak hours. More recently, thermal storage associated with water heaters has demonstrated the ability to participate in the ancillary services markets. In addition, microgrid demonstrations are underway that integrate storage into the portfolio of onsite resources, such as distributed generation or demand response capability. Furthermore, storage can play a role in assisting with integrating intermittent renewables on a customer site, and with providing temporary back-up power services.

3. Methodology

The methodology used in the U.S. energy storage market assessment involved quantifying key storage market application areas, creating a market penetration “S-curve” for each energy storage application area, and assessing the yearly MWs of energy storage penetration. From the annual MW estimates, the market model then calculated the associated copper demand that can be expected in each of the application areas. Figure 7 offers a visual of this methodology, depicting KEMA’s conceptual approach:

1. Examine and identify the energy storage applications poised for the largest near-term growth and assess their current market size and maximum five-year market potential.
2. Assess the cost and revenues of energy storage technologies in each of these applications.
3. Estimate the economic payback period for each of the selected technologies and applications, and create penetration curves for each bundle.
4. Estimate the likely five-year market sizes, in MWs, for each bundle based on the paybacks, market penetration curves, and maximum potential.
5. Estimate the copper intensities, in tons per MW, of the storage devices and of the full configurations required for installation.
6. Calculate the estimated copper demand associated with the near-term storage market.

Figure 7. U.S. Energy Storage Market Penetration Methodology Overview

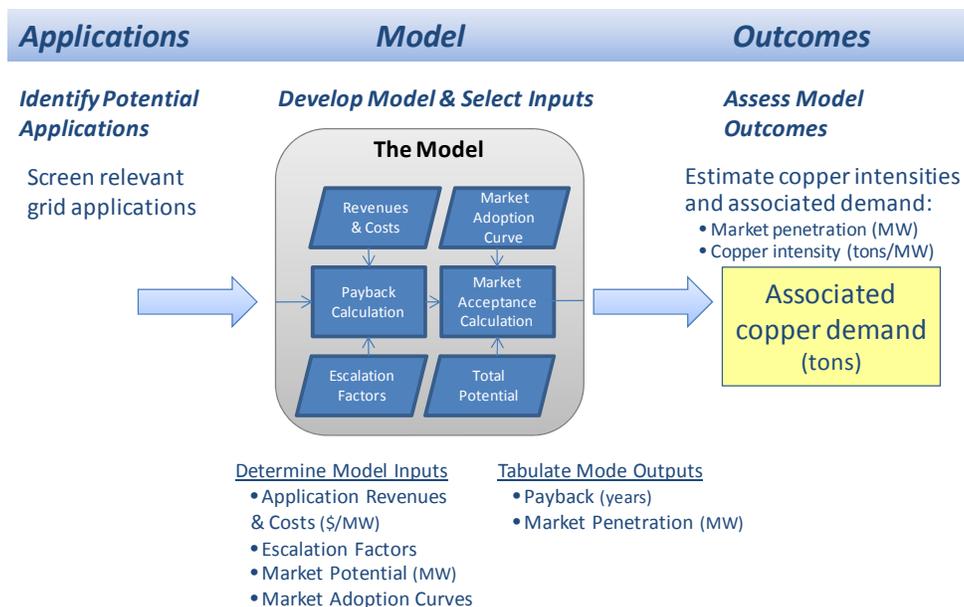

3.1 Market Penetration Model Summary

KEMA used its market penetration model to assess the potential size of specific energy storage applications in selected markets. The model is designed to determine year-on-year penetration rates, in MWs, for specific identified applications. The model outputs are cumulative and annual penetration rates for the defined energy storage application.

The energy storage market model estimates market penetration based on penetration curves defined by application and based on payback calculations per technology/application bundle. To assess payback, the model incorporates characteristics of the device such as cost, duration, and expected decreases in cost of each application over the time horizon of the analysis. Benefits for each application are determined and used to create an average payback for that year of operation. For each application, the model inputs a maximum technical potential. The maximum technical potential is the size of the market that a storage device *could* obtain, based on technical feasibility regardless of project economics or other limiting factors. Addressable market sizes and growth are derived from technical market potential estimates that are based upon reasonable assumptions about technology, market readiness, and persistence of outstanding challenges. For a given storage application, the addressable market size provides an upper bound on the amount of achievable market penetration. The model also includes parameters to limit growth in the first and subsequent years so as not to exceed what the storage industry could realistically accomplish. As such, for each year, the payback is compared against the penetration curve and the addressable market to create the yearly penetration. The yearly amount is then summed to create a cumulative total of the cost/market data and market potential. Figure 8 provides a snapshot of the model dashboard.

Figure 8. KEMA Market Penetration Model Dashboard

Starting Year:		2011		Cost Scenario:		Mid	
Payback Calculation Inputs							
Application Type	Ancillary Services	Ancillary Services	CES	CES	CES	Transmission	
Technology Type	Flywheels	Lithium Ion	Lithium Ion	Lead Acid	Nickel Battery	Nickel Battery	
Tax Credit Amount (%)	0%	20%	20%	20%	20%	20%	
Tax Credit Start Year	2012	2012	2012	2012	2012	2012	
Tax Credit End Year	2017	2017	2017	2017	2017	2017	
Penetration Calculation Inputs							
Technical Potential	1,893	1,893	52,500	52,500	52,500	9,143	
Technical Market Growth Rate (%)	10%	10%	1%	1%	1%	2%	
Penetration curve P1	20%	18%	3%	3%	3%	5%	
Penetration curve Y1	15	14	6	6	6	10	
Penetration curve P2	70%	68%	70%	70%	70%	80%	
Penetration curve Y2	2	2	3	3	3	6	
Enter Penetration End Year (Max. 2030)	2016		Select Scenario:		Baseline		
Penetration Results							
Cumulative Tons of Copper Through 2016	Ancillary Services	Ancillary Services	CES Lithium Ion	CES Lead Acid	CES Nickel	Transmission	
Cum Mkt Pen - Base (MW)	105	151	6	0	0	26	
Cum Mkt Pen w Tax Credit (MW)	105	227	70	10	5	47	
Cum Tons of Copper - Base (tons)	231	405	28	2	1	27	
Cum Tons of Copper w Tax Credit (tons)	231	608	309	40	20	49	

3.2 Costs and Payback Periods

Today, advanced energy storage markets are generally in a pre-commercialized stage. As such, the cost of energy storage devices is expected to decrease over the next 20 years. In addition, energy storage is comprised of a number of competing technologies at varying price points. To address these factors, KEMA listed developing energy storage technologies across a range of durations. These average cost curves were used to estimate the expected cost of energy storage over time. KEMA estimated the economic payback period for each of the energy storage applications over the five-year study period. The payback period was determined by dividing the initial cost of the storage equipment by the net annual benefit derived from the storage equipment to determine the period of time required for the benefits to repay the original investment. Costs represented total installed costs, which included the battery system, power conversion systems, engineering, site work, and shipping.

The net benefits were determined for each storage application based upon a combination of primary and secondary research. The net benefits were determined by identifying the possible

value streams for storage, which could include electricity sales or avoided electricity costs less the costs of operating the storage device. For some storage applications, an escalation factor was applied to account for changes to the net benefits over the five-year study period. The combination of decreasing cost curves and increasing storage benefits resulted in payback curves that improved over the course of the analysis study period. Payback curves were calculated with and without a tax incentive.

3.3 Copper Intensity

With many storage applications in the demonstration phase, energy storage installations have yet to conform to standard configurations. Though energy storage installations come in a wide array of sizes and configurations, and though few best practices have evolved with regard to defining storage configuration, common pieces of equipment will likely be needed to interconnect energy storage to the electric grid. Such equipment includes:

- Transformers
- Interrupting devices (breakers and switches)
- Protection and communication systems
- Monitoring and control systems
- Inter- and intra-system wiring

To develop estimates of the magnitude of copper demand associated with installed applications of energy storage, KEMA estimated representative configurations based on manufacturer interviews and industry experience. KEMA used copper intensity ranges from published research, interviews with storage developers and interviews with copper experts.


The ranges address two sources of uncertainty:

- Configurations
 - A variety of potential applications, from low-voltage to high-voltage installations, means that there can be a variety of electrical equipment associated with storage installations. Furthermore, best practices are yet to develop.
- Electrical equipment copper intensity
 - Electrical equipment offers a range of copper intensities, depending on sizes, but also depending on market offerings. KEMA used reasonable ranges for the devices to note impacts on total tonnage.

Figure 9 depicts a generic configuration, representative of those used to estimate the copper intensity of storage installations. Storage device intensities described prior were used to estimate unit intensities. The copper content of the associated electrical equipment was estimated based on sample configurations either planned or already in the field. The copper content of the electrical equipment was estimated based on assumptions about equipment sizes and types. The following are the ranges in quantity and unit size, respectively, per installation:

- Power transformers—1 to 11; 25 kW to 360 MW
- Breakers—1 to 20; 480V to 138 kV
- Generators—2 to 200; 100 kW to 300 MW
- Inverters—1 to 48; 5 kW to 3.5 MW
- Cooling—small window units to large rooftop systems
- Grounding—several feet to miles; #4 Cu to 4/0 Cu

Figure 9. Storage Installation Methodology

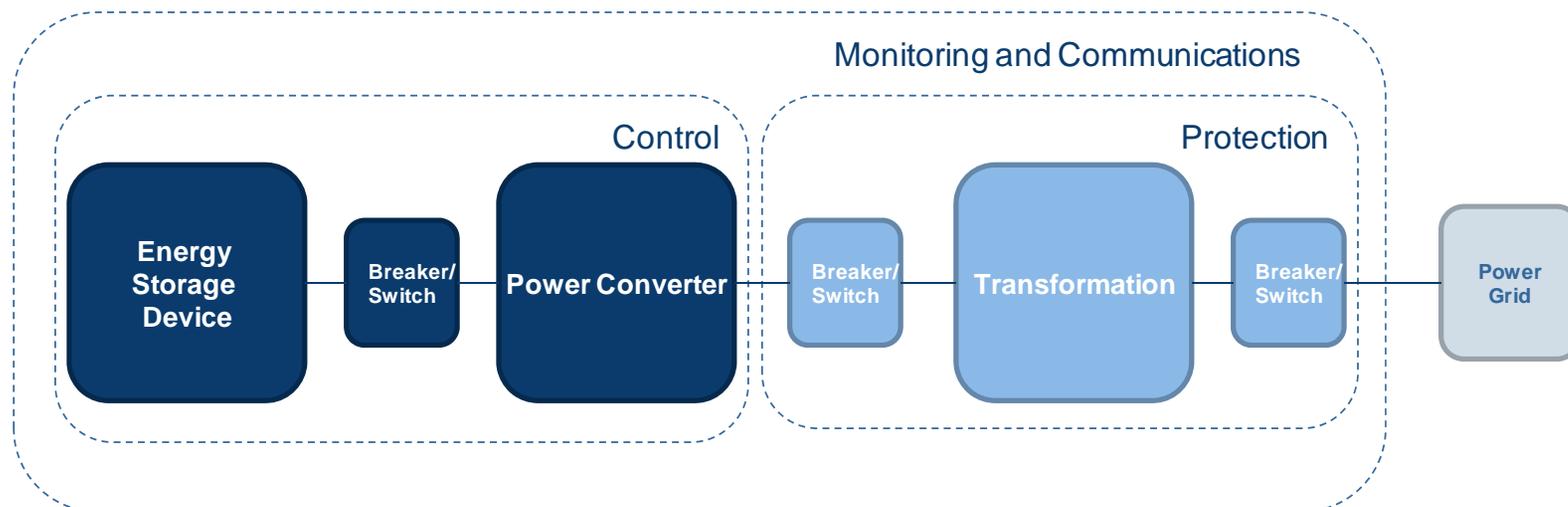


<p>Copper content varies by storage technology.</p> <p>Large generators used for pumped storage or CAES and internal connections for battery technologies largest copper contributors.</p>	<p>Low voltage interrupting devices typically have very small amounts of copper</p> <p>Some installations may have a large enough quantities to contribute significant copper.</p>	<p>Copper content determined by inverter size and quantity.</p> <p>Applications such as Transmission and Ancillary services require larger inverters for larger systems.</p>	<p>Distribution level switchgear assemblies utilize copper for internal bus bar connections.</p> <p>Lower voltage equipment also typically uses more copper.</p>	<p>Transformations to low or mid-level voltages (collector systems) and dist or trans (interconnection to grid) contribute significant amounts of copper.</p> <p>Cu content depends on voltage level, size and quantity of transformers.</p>	<p>High voltage circuit breaker copper use primarily for breaker contacts.</p>
<p>Monitoring and Communications utilize small copper conductors. Trends moving to wireless and fiber optic communication.</p> <p>Protection devices typically utilize copper alloys for contacts, minimal copper usage.</p> <p>Control utilize smaller copper conductors.</p> <p>Largest Cu contributor – Instrument transformers and sensors. Lower voltage sensors use less copper.</p>					

4. Relevant Initiatives in Energy Storage

A number of policy initiatives are underway that will impact the energy storage market in the U.S.—some directly and some indirectly. A notable initiative that has had a strong impact in the past year, and whose efforts will likely continue to make an impact in coming years, is the provision of matching funds by the U.S. Department of Energy (DOE) to support energy storage projects. According to a 2011 report by the Electricity Advisory Committee on energy storage activities in the U.S., the funds provided by the federal government totaled almost \$185 million and supported projects valued roughly at \$772 million in total. Associated with these projects was approximately 537 MW of storage capacity, including storage for ancillary services (20 MW), distributed storage (7.5 MW), CAES (450 MW), and storage associated with renewable power (57 MW). Figure 10 illustrates the breakdown of American Recovery and Reinvestment Act funding by storage technology type.

Figure 10. DOE Smart Grid Demonstration Grants

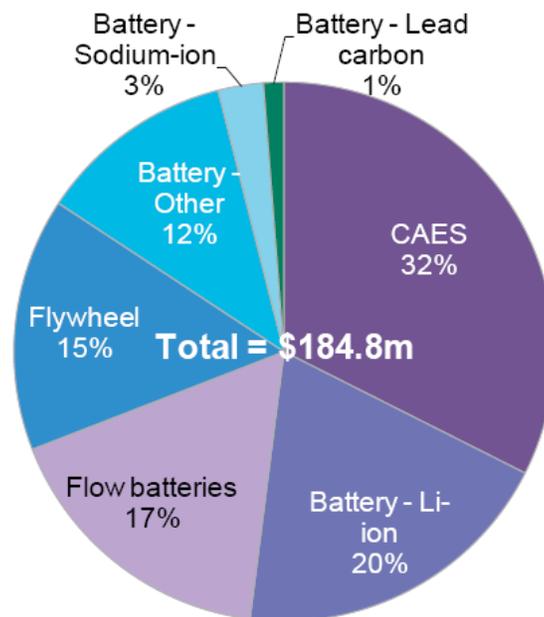

Source: Bloomberg Finance, April 2011

In addition to the injection of public funding for demonstration projects, the U.S. storage market has also witnessed a surge of private investment. According to a recent survey by Ernst & Young, energy storage was the largest segment for cleantech investment in the third quarter of 2011, increasing by 1,932 percent over the same period last year. Overall, the energy storage

segment raised \$865.2 million up through the third quarter of 2011, with \$421 million raised during the third quarter.

Several recent national and regional policy initiatives are also likely to impact the U.S. energy storage market in the near- to mid-term. Figure 11 provides a summary of some of the notable policy initiatives likely to impact the U.S. energy storage market.

Figure 11. Policy Initiatives Shaping the U.S. Energy Storage Market

Initiative	Description	Market impact
FERC Final Rule (RM11-7-000; Final Order No. 755)	Clarifies frequency regulation compensation for quick-response storage services in the wholesale markets (Oct. 2011)	TIME FRAME: Near/Mid-term • Potential increase in regulation revenues due to higher value with fast response resources
California State Law (AB 2514)	Sets energy storage procurement targets in the State of California (Enacted 2010)	TIME FRAME: Near/Mid-term • Increased awareness of storage capability and benefit
U.S. STORAGE Act of 2011 (S.1845)	Legislation would provide tax incentives for grid storage as well as for on-site and residential applications. (Introduced Nov. 2011)	TIME FRAME: Longer-term • Accelerate the market by defraying initial investment
ISO/RTO Ancillary Markets Currently Open to Storage (PJM, NYISO, ISO-NE, MISO, CAISO)	Five open-bid energy markets including ancillary market participation, are now accessible to energy storage: PJM, NYISO, ISO-NE, MISO and CAISO (Underway as of 2011)	TIME FRAME: Near-term • Creates an incentive to use storage for regulation
ISO/RTO Storage Ancillary Market Participation Pending (ERCOT)	ERCOT is considering new rules for storage participation in the ancillary services markets. (In process as of 2011)	TIME FRAME: Near/Mid-term • Expanded market for regulation
Renewable Portfolio Standards (29 states & DC – 16 state w/solar & DG provisions)	RPS mandates and goals to increase the relative share of renewable capacity / generation. Targets range from 10% - 40% (Hawaii)	TIME FRAME: Near/Mid-term • Increased need to mitigate impacts of intermittency (load following, regulation, voltage disturbances, etc.)

In October of 2011, FERC issued a final rule on frequency regulation compensation, which requires ISOs/RTOs to compensate frequency regulation resources—including energy storage—based on actual performance.⁸ The order, Order No. 755, directs the ISOs/RTOs to create market rules that would implement a “pay for performance” approach, which could result in higher payments for faster responding resources like storage. Expectations are that this rule could have the effect of increasing the revenue that storage devices obtain for providing ancillary services compared to other traditional resources. This is because many energy

⁸ FERC Final Rule RM11-7-000; FERC Order No. 755, 137 FERC ¶ 61,064 (2011).

storage devices have the ability to respond quickly, compared to other resources, and a pay-for-performance approach would reward fast response devices. Final rules for compensation, however, have yet to be determined but are expected to be unveiled in 2012.

Assembly Bill (AB) 2514, from California, is likely to impact all of the applications for energy storage reviewed in this study. This is because it prompts the evaluation of energy storage procurement targets that are technology and application neutral. Though the scope of the policy applies to California only, it could indirectly affect the market as a whole by increasing the awareness of storage capabilities.

The U.S. Storage Act of 2011 represents a push by some members of Congress to create tax incentives for energy storage investments. Various versions of a tax incentive have been discussed, and it is feasible that future efforts could ultimately turn one of these versions into law, affecting all storage applications and potentially accelerating the market by defraying costs.


Currently, the ancillary services markets in five of the U.S. ISOs/RTOs are accessible to energy storage: PJM Interconnection, New York ISO, ISO-New England, Midwest ISO and CAISO.⁹ ERCOT is also considering new rules for energy storage participation in the ancillary services markets. New rules by the Electric Reliability Council of Texas (ERCOT) on storage's ability to provide ancillary services will potentially open the market further in this area.

Finally, renewable portfolio standards are a strong driver for the renewable energy market. This, in turn, will affect the markets for ancillary services and renewable integration applications of energy storage.

Figure 12 provides an overview of recent market developments, by application, noting activities prompted by recent investments and policy. The figure also notes expected time horizons for the development of various application markets.

⁹ CAISO is moving towards inclusion of energy storage for ancillary services with revised market rules undergoing implementation.

Figure 12. U.S. Application Market Development Horizon

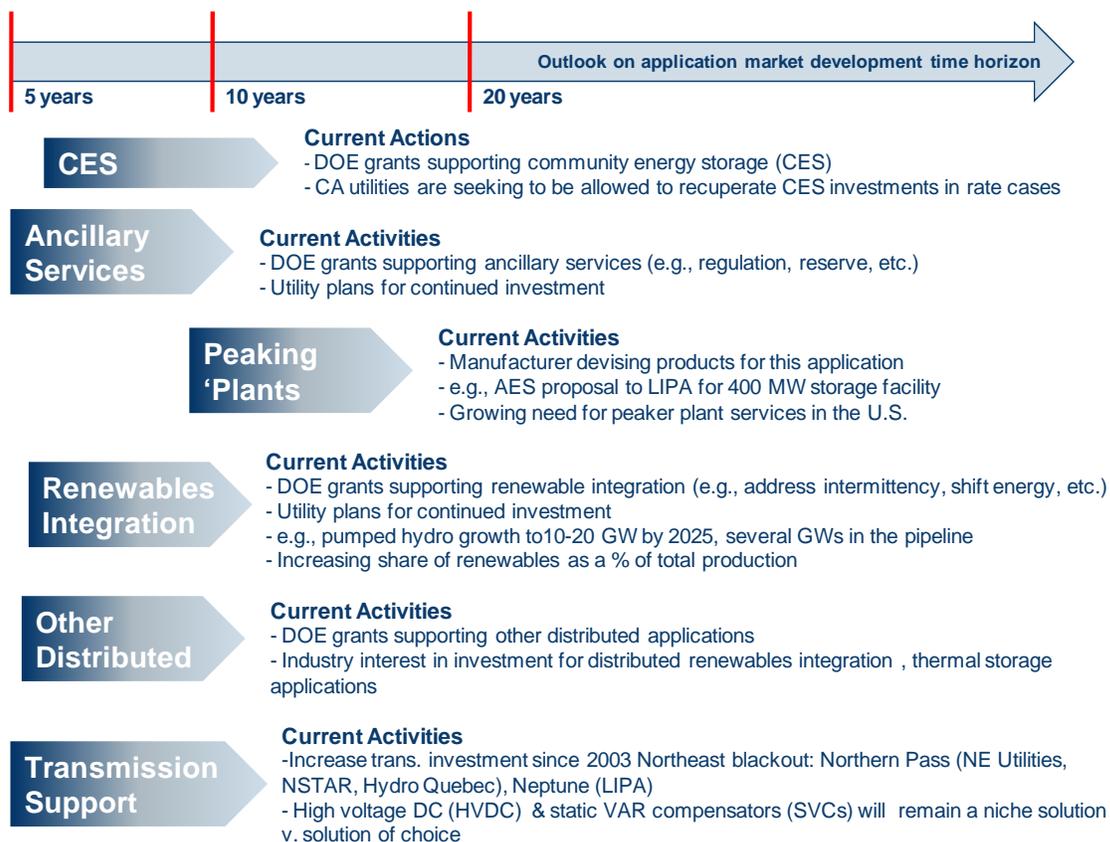

Though additional applications are likely to develop for storage over time, the areas of transmissions support, other distributed storage, renewable integration ancillary services, and CES are expected to be the primary applications for grow in the near term.

5. Results of Market Penetration Study

5.1 Market Summary

Currently, the largest application for storage is distributed storage, primarily in the form of thermal storage used for reducing thermal heating or cooling loads. Renewable energy applications constitute the second largest storage application in terms of installed capacity, primarily due to pumped hydro and CAES systems. The remaining applications and technologies currently constitute less than 10 percent of the installed capacity. Figure 13 depicts the estimated energy storage capacity installed in the U.S. by technology type, and Figure 14 depicts the same by application.

Figure 13. Estimated Current Installed Capacity by Technology (MW)


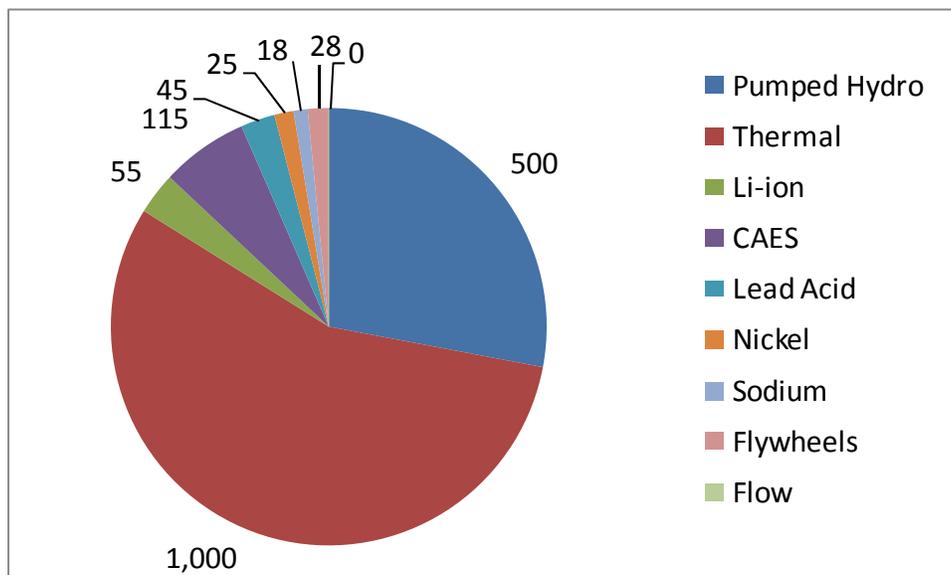


Figure 14. Estimated Current Installed Capacity by Application (MW)

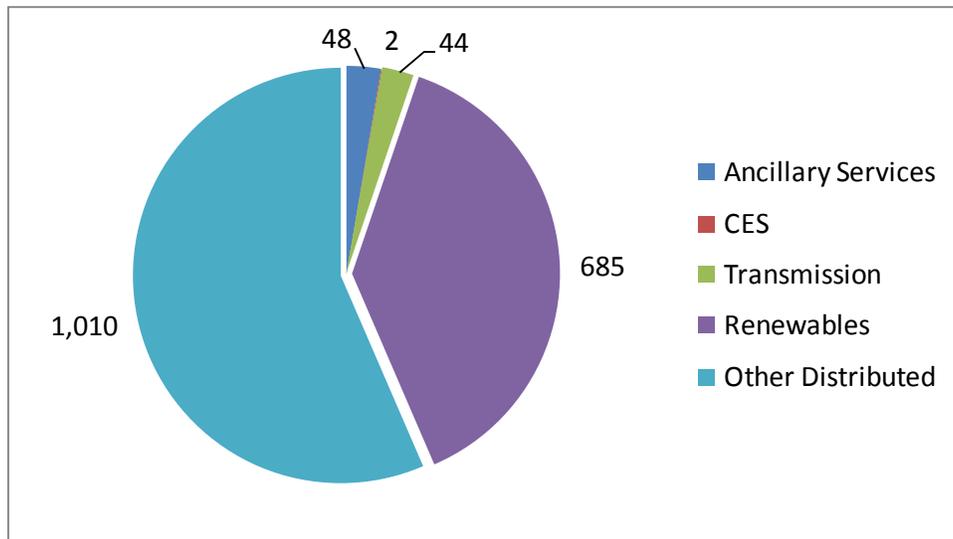

The largest growth in energy storage in the near term is expected to be in other distributed storage, ancillary services, and renewable integration applications. This reflects current investments and trends. The growth in CES and transmission is expected to be gradual, though the potential for the overall CES market is expected to be quite large. Figure 15 illustrates the estimated five-year incremental growth in storage by application.

Figure 15. Estimated Five-year Incremental Growth, by Application, with No Credit


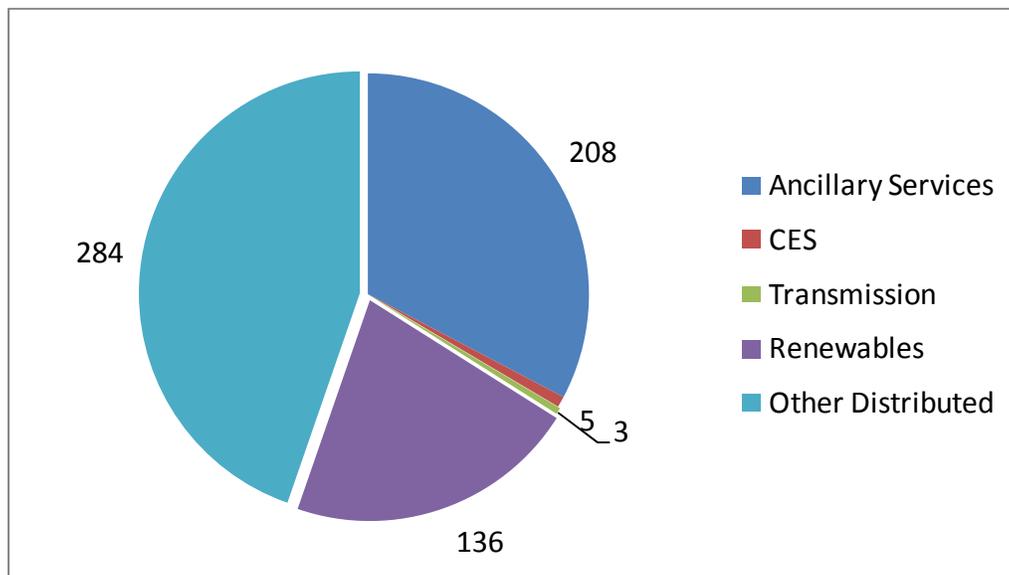


Figure 16 depicts the five-year incremental growth in storage by technology, with no tax incentive. Given the development timescale, pumped hydro is not expected to grow significantly over the next five years. Battery technologies and thermal storage are expected to be the strongest growth areas in the near term.

Figure 16. Estimated Five-year Incremental Installed Capacity by Technology, No Credit

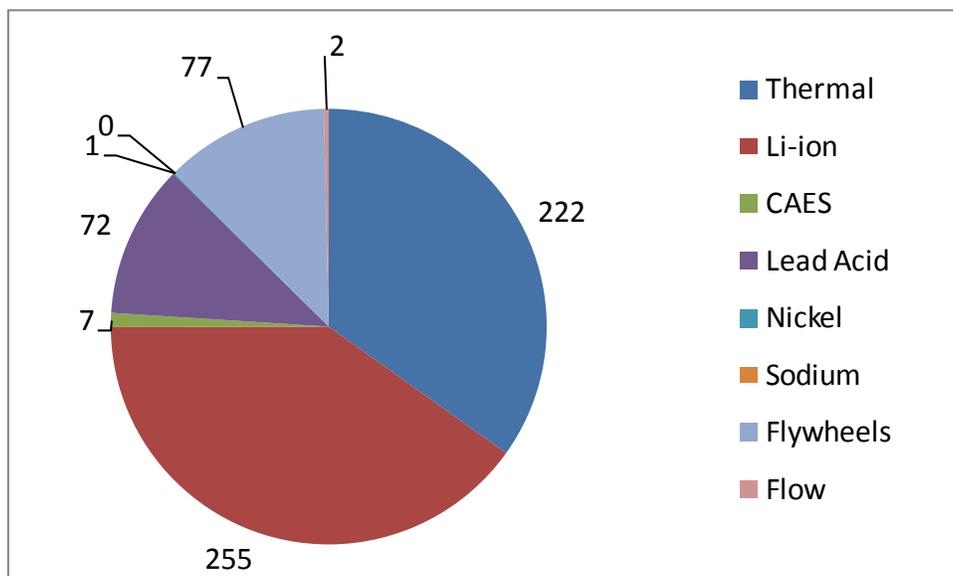

A financial incentive for energy storage could significantly affect the market's size. In particular, CES and transmission applications would be the most affected, in terms of potential percentage change, and renewable integration and other distributed storage would be the most affected in terms of absolute MWs. Figure 17 illustrates the impact of a tax incentive of incremental market growth between now and the next five years.

Figure 17. Estimated Five-year Incremental Installed Capacity by Financial Incentive Scenario


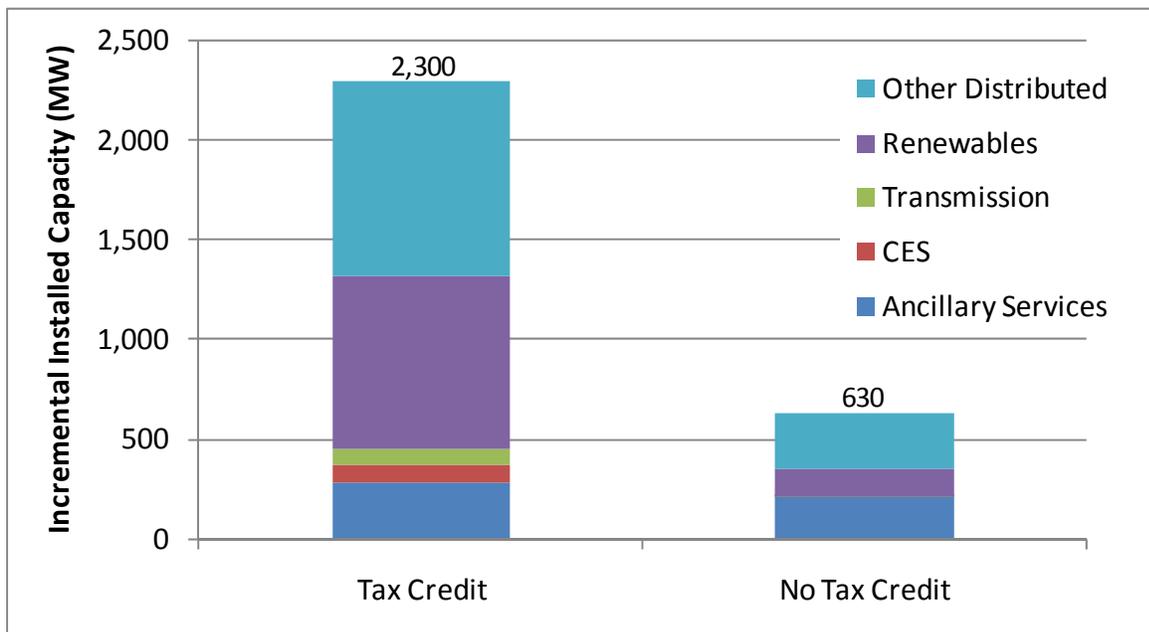



Figure 18 depicts the projected market for storage without a tax incentive by application, and Figure 19 does the same by technology. Distributed storage already has a large share of the market and will likely continue to grow. Energy storage for renewables also has a significant share and will likely experience growth. Overall, the market adoption for ancillary services will likely accelerate but still constitute a smaller share of energy storage.

Figure 18. Estimated Five-year Total Installed Capacity by Application (MW), No Incentive

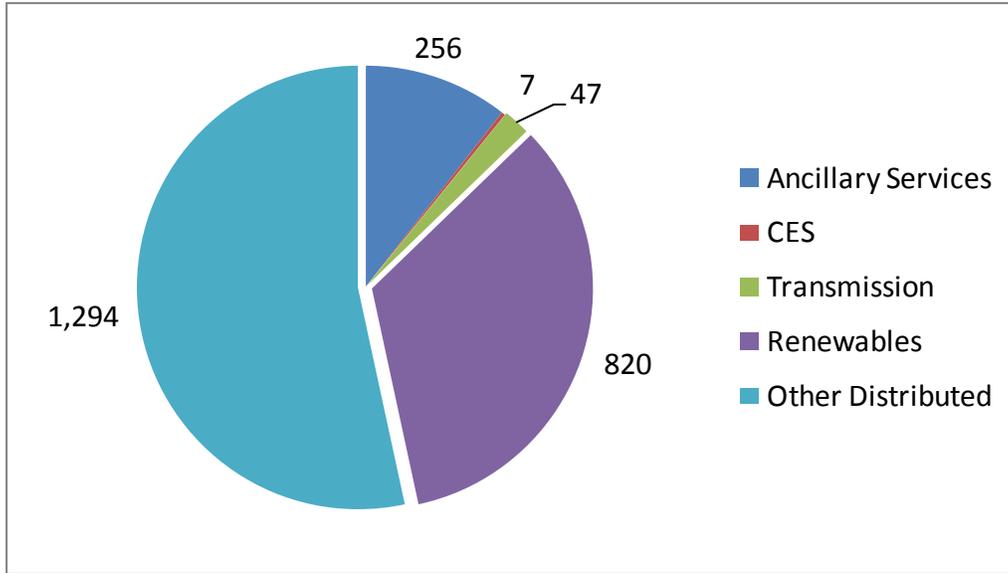

Traditional storage technologies are expected to stay strong over the next five years, as a share of total storage technologies. For example, thermal storage is expected to stay as a large share of total storage, and even without growth, pumped hydro will likely stay a large share. However, growth is expected for the other technologies, including strong growth for lithium-ion batteries.

Figure 19. Estimated Five-year Installed Capacity by Technology (MW), No Incentive

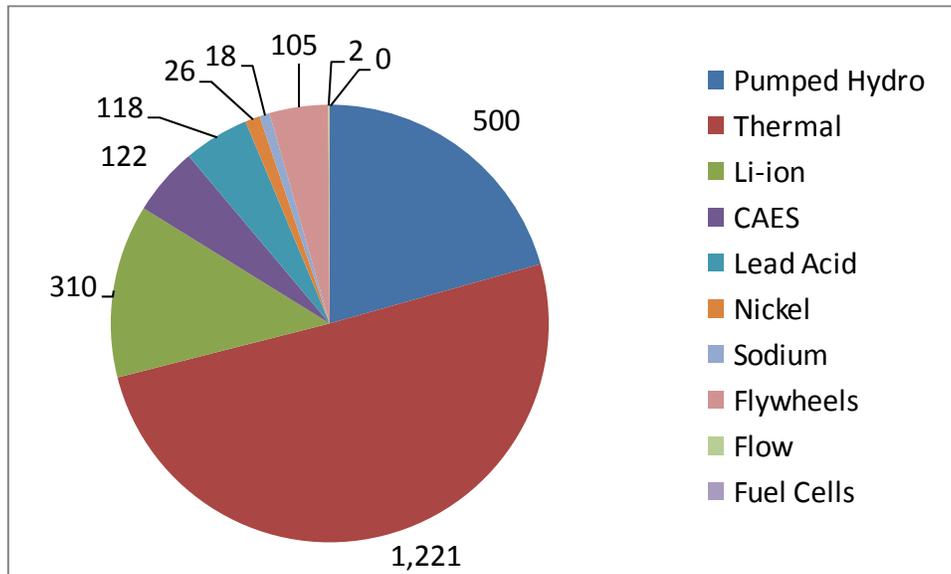

5.2 Market Drivers & Trends

The following sections provide a summary of the key trends shaping the direction and growth of the U.S. energy storage markets:

Ancillary Services/Regulation—Currently, regulation requirements as a percentage of peak load is on the order of one to two percent. With intermittent renewable generation growing to a significant portion of total generation, regulation requirements are expected to grow. Estimates range from a doubling to a tripling of regulation requirements in the wholesale markets by 2020. In addition, the rules governing the participation of energy storage in the ancillary services markets are evolving. The trend is towards an opening of the markets for energy storage technologies, and potentially revised reward mechanisms. Other resource types, such as demand response resources, however, will also likely compete for the expanding market. Over time, as experience with energy storage grows, it is expected that the regulation application will grow outside of the wholesale markets as well.

Renewable Energy Integration—The renewable energy integration storage application is currently evidenced in island grid systems such as the state of Hawaii, where requirements have been put in place to limit the ramping of intermittent renewable sources. In the continental U.S., utilities and the ISO/RTOs understand the potential problems of intermittent generation. However firming requirements are less prevalent. Nevertheless, several demonstrations and test project have begun to increase the size of this market. As the implementation of renewable resources grows, so too will the potential for energy storage for renewable energy integration. Overall, the requirements for addressing renewable intermittency will have a strong impact on the market for this application.

CES Application—Bundled services are generally targeted towards utility-use applications under the CES concept. While bundled services can offer a range of promising benefits, market penetration is subject to the utility timeline for deployment. The CES market tends to be the largest evaluated market in the U.S.—the ability to group multiple applications helps achieve better paybacks and thus higher levels of penetration. However, regulated utilities tend to be highly risk averse. Though the CES market is large, the timeline to large-scale deployment is longer than is typically seen with ancillary services and renewable integration applications. Utilities currently demonstrating or testing CES technologies are American Electric Power, Con Edison, Detroit Edison, Duke Energy, First Energy, and Southern California Edison. Some utilities are currently seeking mechanisms to rate-base CES investments.

Transmission Support— The use of storage for transmission support has been demonstrated through installed projects. However, transmission support services are targeted towards the utility sector, and adoption can be slow due to financing and risk aversion. As such, these markets show promise but how the applications get financed is an open question.

Other Distributed Storage—Thermal storage is growing in market size due to its low cost and recent developments in control technology. Recently, thermal energy storage has been used in demonstrations for the provision of service in the wholesale markets.¹⁰ In addition, the microgrid market is expected to grow quickly in the education campus and military sectors. While several technologies are in the demonstration phase, many believe this market will develop quickly.

5.3 Market Potential Conclusions

In assessing the current and near-term market for grid energy storage, KEMA analyzed the markets for the applications poised for the strongest near-term growth. These include:

- Ancillary services
- Renewables energy integration
- Transmission support
- Community energy services
- Other distributed applications

Ancillary services are the most promising near-term application. However, this market, due to an increasing number of participants with other technologies capable of providing services and due to fluctuating prices, is not expected to grow in the long term. In the near term, the application is poised for growth.

Renewable energy integration offers a large potential market. However, to date, these applications have been seen only in island applications where the renewable intermittency is already causing issues. In the continental U.S., where penetration of renewables is much less, few requirements exist. This market's development in the long term will be dependent on whether storage becomes a requirement for renewable integration to the grid.

¹⁰ PJM is evaluating the ability of electric water heater thermal storage to provide regulation services via dispatches by PJM.

CES offers the most potential of the applications in the long term because the application taps into multiple revenue sources and the product lends itself to easy installation and production. However, the market will likely be driven by regulated utilities, which likely indicates a slower rise to mass deployment compared to other markets.

The market's development for transmission support is likely to be slow in the near term due to long-time horizons with adoption and difficulties in finding financing. The market for CES could potentially grow faster than transmission support, as the size of the projects tend to be smaller and therefore lower cost.

Other distributed storage will likely continue to grow in the near term. This is in large part due to expectations about the adoption of low-cost thermal energy storage.

In the short term, based on planned investments and policies, the market for renewable integration, other distributed storage, and ancillary services are likely the strongest growth areas in the market.

6. Results of Copper Demand Analysis

6.1 Copper Demand Summary

The near-term U.S. energy storage market could carry an associated demand for copper of thousands of tons of copper. The primary drivers for this demand are expected to be storage associated with ancillary services and renewable energy integration. Additional markets, poised for growth in the longer term, carry additional potential for copper demand.

Figure 20 illustrates the results for storage associated with renewable energy integration. The renewable energy integration applications appear to have a strong associated demand for copper due to expectations about strong market growth and sizeable intensities. In particular, lithium-ion appears to carry the largest associated demand in this area over the near term.

Figure 20. Renewables Integration Copper Demand

Application Type	Renewables	Renewables	Renewables	Renewables
Technology Type	Pump Hydro	CAES	Lithium Ion	Lead Acid
Penetration Results				
<i>Cumulative Tons of Copper Through 2016</i>	Renewables Pump	Renewables	Renewables	Renewables Lead
Cum Mkt Pen - Base (MW)	500	122	144	54
Cum Mkt Pen w Tax Credit (MW)	500	234	639	180
Cum Tons of Copper - Base (tons)	159	56	375	75
Cum Tons of Copper w Tax Credit (tons)	159	108	1,660	250

Figure 21 illustrates the results for the ancillary services market. Energy storage for ancillary services appears to have a strong associated demand for copper, due to its relatively high copper intensities and expectations about near-term growth.

Figure 21. Ancillary Services Market Copper Demand

Application Type	Ancillary Services	Ancillary Services
Technology Type	Flywheels	Lithium Ion
Penetration Results		
<i>Cumulative Tons of Copper Through 2016</i>	Ancillary Services	Ancillary Services
Cum Mkt Pen - Base (MW)	105	151
Cum Mkt Pen w Tax Credit (MW)	105	227
Cum Tons of Copper - Base (tons)	231	405
Cum Tons of Copper w Tax Credit (tons)	231	608

Figure 22 illustrates the results for the transmission services application. Transmission is potentially limited in its near-term associated demand for copper though the copper intensities can be relatively strong. This limitation is because of expectations about slow market growth.

Figure 22. Transmission Services Copper Demand

Application Type	Transmission	Transmission	Transmission
Technology Type	Nickel Battery	Flow Battery	Sodium
<i>Cumulative Tons of Copper Through 2016</i>	Transmission	Transmission	Transmission
Cum Mkt Pen - Base (MW)	26	2	18
Cum Mkt Pen w Tax Credit (MW)	47	58	21
Cum Tons of Copper - Base (tons)	27	6	55
Cum Tons of Copper w Tax Credit (tons)	49	143	61

Figure 23 illustrates the results for the other distributed storage applications. Though the market for thermal storage is relatively large, the copper intensity is relatively limited, limiting the overall associated copper demand. The markets of non-thermal types of other distributed storage are likely to be slow, limiting near-term demand for copper.

Figure 23. Other Distributed Storage Copper Demand

Application Type	Other Distributed 1	Other Distributed 1	Other Distributed 2	Other Distributed 2	Other Distributed 3
Technology Type	Lithium Ion	Lead Acid	Lithium Ion	Lead Acid	Thermal (cold)
<i>Cumulative Tons of Copper Through 2016</i>	Other Distributed 1	Other Distributed 1	Other Distributed 2	Other Distributed 2	Other Distributed 3
Cum Mkt Pen - Base (MW)	5	61	4	3	1,221
Cum Mkt Pen w Tax Credit (MW)	8	91	7	5	1,877
Cum Tons of Copper - Base (tons)	11	26	15	1	49
Cum Tons of Copper w Tax Credit (tons)	20	39	24	2	75

Figure 24 illustrates the results for CES. CES appears to be a limited market for copper intensity in the near term, due to expectations about limited market growth over the next five years. However, because of its relatively high copper intensity and potential for large mid- to long-term growth, this area could have strong associated copper demand.

Figure 24. CES Copper Demand

Application Type	CES	CES	CES
Technology Type	Lithium Ion	Lead Acid	Nickel Battery
<i>Cumulative Tons of Copper Through 2016</i>	CES Lithium Ion	CES Lead Acid	CES Nickel
Cum Mkt Pen - Base (MW)	6	0	0
Cum Mkt Pen w Tax Credit (MW)	70	10	5
Cum Tons of Copper - Base (tons)	28	2	1
Cum Tons of Copper w Tax Credit (tons)	309	40	20

6.2 Storage Unit Copper Intensities

The per-unit copper potential of storage devices can vary significantly by technology. However, copper can play a fundamental role in their make-up. For example, some battery chemistries use copper in battery cells as current collectors. An additional component where copper is used is in internal wiring to connect the battery cells. Battery voltages and energy densities can determine the wiring needs for a storage unit. For many types of mechanical storage, motors or large generators can be significant contributors to copper intensity.

Figure 25 summarizes the copper densities in tons per MW by technology type. Lithium-ion, flow, and sodium batteries as well as flywheels, CAES, and pumped hydropower are strong users of copper at the unit level.

Figure 25. Storage Unit Copper Intensities

Technology	Copper Density (tons/MW)	Comments	Unit Copper Potential
Pumped Hydro	0.11 – 0.16	Generator only; full configuration follows	●
CAES	0.18 – 0.26	Generator & compressor motor only; full configuration follows	●
Flywheel	0.23	Defined as module only	●
Lithium-ion	0.22	Battery pack	●
Sodium	0.25	Battery pack	●
Flow	0.27	Battery pack	●
Lead Acid	0.01	Limited to no use in battery pack	●
Nickel	0.08	Limited use in battery pack	●
Thermal	0.03	Limited copper in device or for installation	●
Super capacitor	Little to none	Limited to no use of copper	●

6.3 Copper Intensities of Installed Storage Applications

Figure 26 illustrates the copper intensity of storage, in tons per MW, by technology, and application. The copper content of storage installations appears to be significant—ranging from zero to more than four tons per MW. The estimates vary based on technology type, configuration, and type of electrical equipment used for the installation. CES application offers the high copper intensity. This is due in large part because it uses more low-voltage equipment than other applications, which generally have higher copper intensities. On average, transmission and ancillary services offer sizeable intensities, and renewable and other distributed storage offer low intensities. The other distributed storage market is dominated by thermal storage, which has lower intensities.


Figure 26. Copper Intensity of Storage Installations

Application	Ancillary Services		CES			Renewables				Transmission			Other Distributed		
Technologies	Flywheel	Li-Ion	Li-Ion	Lead Acid	Nickel	Lead Acid	Pumped Hydro	CAES	Lithium Ion	Nickel	Flow	Sodium	Li-Ion	Thermal	Lead Acid
Estimated Intensity Tons Cu/MW	2.2	2.7	4.4	4.2	4.3	1.4	0.3	0.5	2.6	1.0	2.5	3.0	3.5	0.0	0.4
Low Tons Cu/MW	2.1	2.5	3.8	3.6	3.7	1.4	0.3	0.4	2.2	1.0	2.3	2.6	2.7	0.0	0.4
% Difference from Baseline	4%	5%	14%	14%	14%	1%	7%	9%	13%	4%	7%	13%	21%	0%	10%
High Tons Cu/MW	3.4	3.8	8.3	8.1	8.1	1.7	0.5	0.7	3.8	1.1	3.9	4.0	3.7	0.0	0.5
% Difference from Baseline	55%	41%	87%	92%	90%	20%	62%	58%	46%	3%	59%	36%	6%	0%	10%

6.4 Copper Intensity of Associated Industries

In addition to prompting demand based on its own installations, energy storage has the potential to promote other industries where market is copper intensive. For example, energy storage has the potential to facilitate the integration of distributed and centralized renewable generation to the U.S. grid. In particular, storage can help address the impacts of renewable intermittency, at the generation source or in the wholesale markets, and it can help address stymied investments in the transmission that connects remote renewable sources. Debate today focuses on whether storage should be used as an integration tool for renewable generation, as compared to other resources. Figure 27 illustrates the different options for renewable integration, as presented by the American Wind Energy Association.

Figure 27. Flexibility Supply Curve

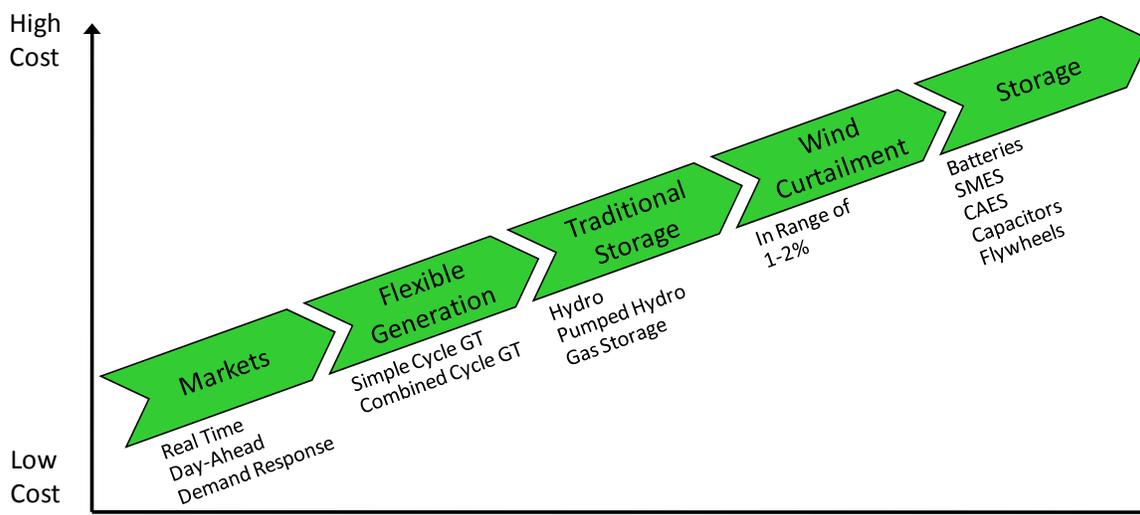

Source: AWEA 2009

In this chart, storage is presented as the most expensive option. However, though storage costs are declining, it is noted that costs may not be the only driver in determining which solution is the better approach. Other resources listed in Figure 27 may have limited capacity or trade-offs that favor storage for some applications, such as emissions, ramping limitations, societal costs, or fatigue. Studies are ongoing to determine the relative emissions effects of storage devices and the realizable potential of demand response, and conversely, developments are being made to increase the flexibility of traditional gas turbines and wind turbines in order to minimize the trade-offs listed. Nevertheless, it is expected that energy storage could play a role in the integration of renewable energy.

Per prior studies commissioned by the CDA, the copper intensity of centralized renewable plants can be significant. The copper intensity of an average wind farm can total from about three tons to six tons per MW while that of an average centralized solar plant can total from around two tons to five tons per MW.

7. Conclusions and Recommendations

Industry analysts forecast that the *global* market for energy storage over the next 10 to 20 years could be upward of 300 GW in size and \$200–\$600 billion in value. KEMA estimates that the energy storage market in the U.S. is poised for growth, both in the near term and in the long term. In particular, KEMA estimates that the U.S. grid storage market could reach two to four GW by 2016. Near-term growth is expected in part due to past investments as well as the emergence of new policies that will likely promote the market. The long-term market for storage will depend on the ability of suppliers to reduce costs and policies to help formalize application markets.

Copper will potentially play a significant role in the U.S. energy storage market, due largely to the electrical equipment used to integrate these technologies and also due in part to the copper intensity of the devices themselves. Though the technologies and configurations for energy storage applications have yet to standardize, and though many new applications may emerge, initial trends indicate that the copper intensity of grid storage applications can range from zero to more than 4 tons per MW. The total, cumulative demand for copper associated with the storage energy market could total thousands of tons of copper in the next five years.

Key Conclusions:

Based on the above assessment of the grid applications markets as well as the qualification of energy storage technologies that could serve the most promising applications, key conclusions of this study include:

- The ancillary services markets have high marginal revenues and are likely to experience strong growth in the short term. In addition, they have associated with them a sizeable demand for copper. In the long run, however, this application has likely limited potential compared to others. This is due to limited long-term growth in the market as well as the expected competition from other non-storage resources that could decrease prices. Other application markets may take longer to grow but are likely more sustainable in the long run.
- The storage market for renewable integration is expected to grow as the amount of intermittent renewable generation placed on the grid grows. Currently, there are a number of policy targets and incentives promoting renewable generation investment and

a large portion of these planned installations require methods for addressing intermittency. Policies determining which if any integration requirements will be necessary and who will be responsive for them will likely affect how the energy storage market for renewable integration takes shape. In addition, the development of alternative integration means, such as a demand response resource, could affect the energy storage market for this application. Several large, planned storage installations indicate that this market could grow in capacity fairly quickly. The timeframe for hydropower investment means that the majority of these installations in the near term will be battery storage or smaller sized CAES.

- The long-term market for transmission applications is also likely large, and the copper intensity sizeable, but the market is traditionally slow for a variety of reasons, including longer testing and evaluation time horizons and a generally lower tolerance of risk. As such, the near-term growth in this market is expected to be more limited.
- The long-term market for CES applications is expected to be relatively large, and potentially sizeable in copper intensity. However, the market is likely to be slow for similar reasons as the transmission applications. Nevertheless, the market may move more quickly than for transmission applications, because of its smaller sizes – which means lower upfront costs – and because of its modularity which can facilitate cheaper production and installation.
- Other distributed storage types have limited copper content associated with them, due to smaller copper intensities or limited needs for associated electrical equipment. For example, though thermal energy storage currently constitutes a large portion of the current installed base of storage, and though it is expected that this market will likely continue to grow, the overall copper intensity is relatively small. Applications that would use higher copper intensive energy storage technologies, or which would require the use of additional supporting electrical equipment, would need to grow for this area to contribute to copper demand.

Appendix A. Survey

U.S. Energy Storage Market Survey

KEMA, Inc. for the Copper Development Association

Thank you for participating in our study of the U.S. energy storage market. Please call if you have any questions regarding the study, the survey or individual questions. All responses will be kept strictly confidential.

Background

Q1.1 Please list the types of energy storage technology/technologies your organization manufactures/develops:

Q1.2 What percent of your total MW sales of energy storage technology (cumulative, to date) in the U.S. are for the following storage applications? Please note whether the applications are served by distributed vs. centralized devices. *(The following applications are defined by 2010 study from Sandia. A copy of that study, with detailed description of the applications can be found at:*

<http://prod.sandia.gov/techlib/access-control.cgi/2010/100815.pdf>)

— Area Regulation	Distributed	/	Centralized
— Electric Supply Reserve Capacity	Distributed	/	Centralized
— Load Following	Distributed	/	Centralized
— Voltage Support	Distributed	/	Centralized
— Transmission Congestion Relief	Distributed	/	Centralized
— T&D Upgrade Deferral	Distributed	/	Centralized
— Transmission Support	Distributed	/	Centralized
— Substation On-Site Power	Distributed	/	Centralized
— Electric Service Reliability	Distributed	/	Centralized
— Electric Service Power Quality	Distributed	/	Centralized
— Renewables Energy Time-Shift	Distributed	/	Centralized
— Renewables Capacity Firming	Distributed	/	Centralized
— Wind Generation Grid Integration, Short Duration	Distributed	/	Centralized
— Wind Generation Grid Integration, Long Duration	Distributed	/	Centralized
— Solar Photovoltaic (PV) Smoothing	Distributed	/	Centralized
— Electric Energy Time Shift	Distributed	/	Centralized
— Electric Supply Capacity	Distributed	/	Centralized
— Time-of-Use Energy Cost Management	Distributed	/	Centralized
— Demand Charge Management	Distributed	/	Centralized
— Other _____	Distributed	/	Centralized

Current Grid Energy Storage Market Situation

Q2.1 What is the total amount in MWs of your energy storage technology/technologies installed in the U.S. cumulative to date? What % is distributed vs. centralized?

Q2.2 What is the total amount of U.S. MW sales of your energy storage technology for the most recent calendar year? What % is distributed vs. centralized?

Q2.3 What is the percent change (+/-) in your current total U.S. energy storage sales (MW) over the past:

- 1 year
- 3 years
- 5 years

Q2.4 What are the total MWs of your energy storage technology/technologies planned for installation in the U.S. over the next:

- 1 year
- 3 years
- 5 years

Q2.5 What percent of your total energy storage technology U.S. MW sales (cumulative, to date) are for the following market segments?

- Investor Owned Utilities
- Public Utilities (i.e. municipal utilities, electric utility cooperatives)
- Independent Power Producers / Renewable Project Developers
- U.S. Military
- Commercial & Industrial End-Users
- Campuses (i.e. public schools, universities, office/light industrial parks, port authorities)
- Rural / Agriculture
- Other (describe) _____

Q2.6 What percent change (+/-) have you seen in these market segments MW sales over the last year?

- Investor Owned Utilities
- Public Utilities (i.e. municipal utilities, electric utility cooperatives)
- Independent Power Producers / Renewable Project Developers
- U.S. Military
- Commercial & Industrial End-Users
- Campuses (i.e. public schools, universities, office/light industrial parks, port authorities)
- Rural / Agriculture
- Other (describe) _____

Q2.7 Is your company undertaking research & development on grid energy storage technology?

- Yes
- No

IF YES ↓

Q2.7a What percent of your R&D efforts are focused on:

- Component Development (parts, cells - cathode, anode, electrolyte, separator, other)
- Component Fabrication (parts, cells) & device assembly
- Product Development (prototype battery systems; systems analysis)
- Applied Research (overcome barriers to large-scale usage)
- Performance & Abuse Testing & Analysis
 - Calendar life and cycle life studies
 - Abuse tolerance studies
- Materials
- Other _____

Q2.8 Do you see any of the R&D efforts (either yours or for the industry as a whole) affecting the performance or cost of storage technologies over the next 5 years? If so, please describe what those changes might be and how they would affect the market for storage in the next 5 years?

Future Grid Energy Storage Market Directions

Q3.1 What, if any, do you see as the key technology advancements needed to position energy storage, in general, as a tool for mass adoption vs. a technology with niche applications in the U.S.?

Q3.2 Which, if any, of the following trends help support the growth of the energy storage market/demand for energy storage technologies in the U.S.? On a scale of 1-3, where 1 = does not help support growth, 2 = somewhat helps support growth, and 3 = strongly supports growth

- Growth in grid connected renewable energy generation
- Growth in electrification of transportation (i.e. electric vehicles)
- Growth in time-of-use cost management & demand response
- Electricity price factors – wholesale, retail, ancillary service prices
- Growth in peak load demand
- Aging assets
- Transmission Congestion
- State Renewable Portfolio Standards (RPS)
- State Renewables Interconnection Standards
- State Renewables Ramp Control Standards
- Other _____

Q3.3a Which, if any, of the following market drivers do you see helping to support growth of the energy storage market in the U.S.?

- Federal / State Investment Tax Credits
- Federal / State Production Tax Credits
- Federal tax incentives for energy storage investments
- Federal / State policies, guidelines, and incentive for renewables
- Regulations that support “bundling” of grid applications (i.e., right to earn revenue)
- Research & development efforts
- Field-based demonstration projects
- Geographic & permitting challenges associated with new T&D infrastructure
- Smart grid ability to control distributed resources
- Demand / development of microgrids
- Synergy with electric transportation batteries
- Electric service reliability standards
- Economies of scale (number of units installed)
- Others? _____

Q 3.3b Which, if any, of these drivers (listed above) are *necessary* for *mass deployment* of storage to occur (beyond the demonstration phase)?

Q3.4a Which, if any, of the following do you see as the key barriers to grid energy storage in the U.S.?

- Complex value stream/difficult to determine the value
- Limited regulatory 'permission' to use storage and/or share benefits among stakeholders
- High installed costs relative to internalizable benefits
- Operations & maintenance costs
- Infrastructure needed to control and coordinate grid energy storage
- Payback on investment
- Materials cost
- Manufacturing not yet to scale
- Uncertainties around standards needed to address design, application, and interconnection
- Regulatory uncertainties around asset classification/multiple benefits across distribution, transmission, and generation
- Uncertainties around how grid energy storage should be metered and settled in the market – as a load resource for capital deferral or for enhanced customer reliability
- Key stakeholders have limited or no familiarity with storage technology and/or benefits
- Performance improvements
- Other? _____

Q 3.4b Which, if any, of these barriers (listed above) *must be overcome* for *mass deployment* of storage to occur (beyond the demonstration phase)?

Q3.5 By what amount, if any, would grid energy storage cost / kWh *need* to be reduced to support *mass adoption* of storage in the U.S.?

- Factor of 2
- Factor of 4
- Factor of 10
- Other / More _____

Q3.6 What are your *expectations* about cost reductions for your current technology in the next 5 years?

- Factor of 2
- Factor of 4
- Factor of 10
- Other / More _____

Q3.7 Which, if any, energy storage application areas do you see showing the greatest technical and market growth potential in the U.S. over the next 5 years? Please rank on a scale from 1 to 4 which show the greatest potential, with 1 being greatest potential.

- Community energy storage (kW)
- Other distributed energy storage (kW) (*Customer, PV, etc.*)
- Utility-scale energy storage (250 kW to \geq 1 MW) (*Transmission & Distribution*)
- "Bulk" energy storage (Multiple MWs) (*Generation*)

Q3.8 What is the total market size (in MW) you see for each of these application areas

- Community energy storage (kW)
- Other distributed energy storage (kW) (*Customer, PV, etc.*)
- Utility-scale energy storage (250 kW to \geq 1 MW) (*Transmission & Distribution*)
- "Bulk" energy storage (Multiple MWs) (*Generation*)

Copper in Grid Energy Storage Technologies

Q4.1 What, if any, is the amount of copper used in your storage device? Please note copper intensities (tons/MW) for the storage device only.

Q4.2 What, if any, are the supporting components / equipment for integrating your energy storage device for its primary applications, noted in Q1.2? (e.g., Inverters, Power Control System (PCS), Capacitors, Other)

Q4.3 What, if any, is the amount of copper used in these components / equipment. Again, please note copper intensity where feasible.

Q4.4 What, if any, is the amount of copper used in your grid energy storage device production?

Q4.4b What step in the device production process is most copper-intensive?

Q4.5 Do you believe that the copper intensity of your product or the supporting components would change over time? If so, please describe how?

Industry Initiatives

Q5.1 What do you believe are significant initiatives in the industry today (e.g., research, policy, advocacy, etc.) that would likely most affect the *market for storage* in the next 5 to 10 years? (Please note current and planned)

Current

Planned

Q5.2 What do you believe are significant initiatives in the industry today (e.g., research, policy, advocacy, etc.) that would likely most affect the *copper content of storage* in the next 5 to 10 years? (Please note current and planned)

Current

Planned

Appendix B. Grid-connected Storage Applications

This appendix describes the grid-connected storage applications listed in Sandia Report 2010-0815. In the SANDIA report, 19 grid-connected storage applications are overviewed. For each application, technical considerations are summarized, the financial benefit is calculated, and the market potential of that application is estimated for California and is extrapolated to the U.S. Figure B-1 is the summary of the result as it appears in SANDIA report.

Figure B-2 divides potential energy-storage applications into four groups, depending on the required discharge duration and frequency of use. Frequency of use separates applications that are used routinely, requiring many charge-discharge cycles, from applications that only occasionally call upon the storage device – applications such as back-up power or power quality.

Group 1 includes the applications that require a few hours of often continuous discharge in each cycle. Take “Energy Time Shift” as an example, this application requires energy storage to continuously discharge during the peak hours (3–4 hours), while charge during the off-peak hours. This charge/discharge cycle happens once for each day. Thus, batteries for this group of applications need to have the ability to conduct deep discharges for several thousand times during their lifetime. Load following is an application with a discharge and charge period that can last a few hours but, by definition, it is expected to “follow” the load in a response time that is in minutes.

Group 2 is the applications that require the energy storage device to constantly charge and discharge to compensate/smooth a variable signal such as frequency or output from a variable, renewable generation source. These applications do not require a lot of energy, but they need the battery to have the ability to conduct shallow discharges for hundreds of thousand times during its lifetime.

Group 3 is the applications that also need the energy storage device to deep discharge for each operation. But instead of cycling every day, the battery is only cycled at intervals of several months during the year (T&D deferral) or for several contingency events (Backup or Substation on-site power).

Figure B-1. Copy of Table ES-1 from the Sandia Report 2010-0815

#	Benefit Type	Discharge Duration*		Capacity (Power: kW, MW)		Benefit (\$/kW)**		Potential (MW, 10 Years)		Economy (\$Million) [†]	
		Low	High	Low	High	Low	High	CA	U.S.	CA	U.S.
1	Electric Energy Time-shift	2	8	1 MW	500 MW	400	700	1,445	18,417	795	10,129
2	Electric Supply Capacity	4	6	1 MW	500 MW	359	710	1,445	18,417	772	9,838
3	Load Following	2	4	1 MW	500 MW	600	1,000	2,889	36,834	2,312	29,467
4	Area Regulation	15 min.	30 min.	1 MW	40 MW	785	2,010	80	1,012	112	1,415
5	Electric Supply Reserve Capacity	1	2	1 MW	500 MW	57	225	636	5,986	90	844
6	Voltage Support	15 min.	1	1 MW	10 MW	400		722	9,209	433	5,525
7	Transmission Support	2 sec.	5 sec.	10 MW	100 MW	192		1,084	13,813	208	2,646
8	Transmission Congestion Relief	3	6	1 MW	100 MW	31	141	2,889	36,834	248	3,168
9.1	T&D Upgrade Deferral 50th percentile ^{††}	3	6	250 kW	5 MW	481	687	386	4,986	226	2,912
9.2	T&D Upgrade Deferral 90th percentile ^{††}	3	6	250 kW	2 MW	759	1,079	77	997	71	916
10	Substation On-site Power	8	16	1.5 kW	5 kW	1,800	3,000	20	250	47	600
11	Time-of-use Energy Cost Management	4	6	1 kW	1 MW	1,226		5,038	64,228	6,177	78,743
12	Demand Charge Management	5	11	50 kW	10 MW	582		2,519	32,111	1,466	18,695
13	Electric Service Reliability	5 min.	1	0.2 kW	10 MW	359	978	722	9,209	483	6,154
14	Electric Service Power Quality	10 sec.	1 min.	0.2 kW	10 MW	359	978	722	9,209	483	6,154
15	Renewables Energy Time-shift	3	5	1 kW	500 MW	233	389	2,889	36,834	899	11,455
16	Renewables Capacity Firming	2	4	1 kW	500 MW	709	915	2,889	36,834	2,346	29,909
17.1	Wind Generation Grid Integration, Short Duration	10 sec.	15 min.	0.2 kW	500 MW	500	1,000	181	2,302	135	1,727
17.2	Wind Generation Grid Integration, Long Duration	1	6	0.2 kW	500 MW	100	782	1,445	18,417	637	8,122

*Hours unless indicated otherwise. min. = minutes. sec. = seconds.

**Lifecycle, 10 years, 2.5% escalation, 10.0% discount rate.

[†]Based on potential (MW, 10 years) times average of low and high benefit (\$/kW).

^{††}Benefit for one year. However, storage could be used at more than one location at different times for similar benefits.

Group 4 are applications that need the energy storage device to ride-through some transient events that usually only last several seconds, and don not happen very often. Thus, batteries for these applications only need to conduct shallow discharge cycles a few hundred times during their lifetime. The short response time of battery however is important for these applications.

Figure B-3. Key Energy Storage Requirements by Application Groups

Key Storage Requirements	Group 1	Group 2	Group 3	Group 4
Discharge Duration	hours	Minutes	hours	seconds
Discharge Depth	Deep	Shallow	Deep	Shallow
Minimum Cycle Life	Few 1000's	Hundred of 1000's	Few 100's	Few 100's
Energy Efficiency	Important	Important	Not important	Not important

Following are brief descriptions of the 17 applications listed in the Sandia Report:

Application 1 — Electric Energy Time-shift

Electric energy time-shift means that storage can take advantage of the electricity price difference between on-peak and off-peak hour by purchasing and store energy at times when electricity price is low and selling it back to the grid when the price is higher.

Application 2 — Electric Supply Capacity

Energy storage could be used to defer the cost of installation of new power plant or to “rent” generation capacity in the wholesale electricity marketplace.

Application 3 — Load Following

Energy storage could serve as load following capacity that adjusts its output to balance the generation and the load within a specific region or area.

Figure B-3. Key Energy Storage Requirements by Application Groups

Key Storage Requirements	Group 1	Group 2	Group 3	Group 4
Discharge Duration	hours	Minutes	hours	seconds
Discharge Depth	Deep	Shallow	Deep	Shallow
Minimum Cycle Life	Few 1000's	Hundred of 1000's	Few 100's	Few 100's
Energy Efficiency	Important	Important	Not important	Not important

Following are brief descriptions of the 17 applications listed in the Sandia Report:

Application 1 — Electric Energy Time-shift

Electric energy time-shift means that storage can take advantage of the electricity price difference between on-peak and off-peak hour by purchasing and store energy at times when electricity price is low and selling it back to the grid when the price is higher.

Application 2 — Electric Supply Capacity

Energy storage could be used to defer the cost of installation of new power plant or to “rent” generation capacity in the wholesale electricity marketplace.

Application 3 — Load Following

Energy storage could serve as load following capacity that adjusts its output to balance the generation and the load within a specific region or area.

Application 4 — Area Regulation

Area regulation is the use of on-line generation or storage which can change output quickly (MW/min) to track minute-to-minute fluctuations in loads and to correct for the unintended fluctuations in generation. It helps to maintain the grid frequency and to comply with Control Performance Standards 1 and 2 of the North American Reliability Council.

Application 5 — Electric Supply Reserve Capacity

Reserve capacity is the generation capacity that can be called upon in the event of a contingency such as the sudden, unexpected loss of a generator. Three types of reserve capacities are: spinning reserve, supplemental reserve, and backup supply.

Application 6 — Voltage Support

The purpose of voltage support is to maintain the grid voltage. Common method is to use resources like energy storage to inject or absorb reactive power (VAR) that offsets reactance in the grid.

Application 7 — Transmission Support

Energy storage could be used to enhance the T&D system performance by providing support during the event of electrical anomalies and disturbances such as voltage sag, unstable voltage, and sub-synchronous resonance.

Application 8 — Transmission Congestion Relief

Transmission congestion happens when shortage of transmission capacity to transmit power during periods of peak demand. When the transmission systems are becoming congested, congestion charges are usually applied and increased. Energy storage system would be installed to avoid the congestion related charges and cost. Energy could be stored during the off-peak hours, and be released during on-peak hours, when the transmission systems are congested.

Application 9 — Transmission and Distribution Upgrade Deferral

Energy storage could be installed to defer the installation/upgrade of transmission lines and substations. The market is believed to be necessary due to the difficulty in siting transmission lines/substation, and then once sited, the cost of building the transmission lines/substation. Storage can be utilized to defer the need for the additional lines/substation.

Application 10 — Substation On-site Power

Energy storage system could be used as back-up power at utility substation to provide power to switches and substation communication and control equipments when the grid is not energized.

Application 11 — Time-of-use Energy Cost Management

Energy storage could be used by end users (utility customers) to shift or reduce energy consumption at peak hours to reduce their overall cost for electricity. Energy is purchased at off-peak hours when electricity price is low, and then released at the on-peak hours when electricity price is high.

Application 12 — Demand Charge Management

Energy storage could be used by end users (utility customers) to reduce power consumption when demand charge is high to reduce their overall cost for electricity. Energy is purchased when demand charge do not apply or low, and then discharged when the demand charge do apply or high.

Application 13 — Electric Service Reliability

The electric service reliability application focuses on the need for back-up power systems at commercial and industrial facilities. Usually, the facilities use a combination of batteries for ride-through of momentary outages and then have a diesel generator for longer duration outages.

Application 14 — Electric Service Power Quality

Power quality problem may cause a mis-operation or failure of sensitive industrial equipments and critical commercial operations. Energy storage could be used to improve power quality at end user side against short-duration events such as harmonics, variation in voltage magnitude and frequency and interruptions in service et.al.

Application 15 — Renewables Energy Time-shift

Renewable resources are unpredictable and don't align with typical peak load patterns. For example, wind production tends to peak during the evening and morning hours when load is at a low and ebbs during daytime hours when load is at a maximum. Having a storage device with durations of four to six hours can provide a tremendous advantage to renewable efficiencies, easing of grid impacts, and renewable production. The device will be able to (a) store and discharge renewable generation from low cost periods to high cost periods, (b) provide transmission relief for wind farms – wind farms infrastructure is typically not sized to maximum output of the farm, storage can capture energy that would be typically dumped in these cases and increase wind farm capacity factor.

Application 16 — Renewables Capacity Firming

The objective of renewable capacity firming is to make the generation output somewhat constant. Storage could be used to store wind and solar power during hours of peak production

regardless of demand, and discharge to supplement traditional generation when renewable output reduces during expected generation time.

Application 17 — Wind Generation Grid Integration

As wind generation penetration increases, the electricity grid effects that are unique to wind generation will also increase. Storage could be used to manage or mitigate the less desirable effects from high wind generation penetration. For example, wind farms are beginning to be faced with specific requirements in order to interconnect their devices to the grid. This requirement comes from utility interconnections and well as the power purchase requirements, which can apply penalties to the developers if certain ramping (2%) requirements are not met. Storage can be applied to smooth wind output and off-set these requirements.


Appendix C. Detail on Battery Energy Storage Systems

C.1 System Components and Interconnection

A battery energy storage system consists of batteries, battery management system electronics/control, a DC-to-AC power conversion system, a unit master controller with user interface, thermal management systems and grid interconnection components. Schematics for two possible 1 MW-scale configurations are shown in Figure C-1 and Figure C-2

The single container design shown in Figure C-1 is based on all the components mounted in the same container in order to make it more convenient to transport and install at the end-use site. Typical container lengths are 20 feet, 40 feet and 53 feet. The battery modules are installed in various rack arrangements with battery modules interconnected to get the proper DC bus voltage, power and energy rating. If multiple racks are utilized, then they are connected in parallel by a common DC bus (450 V to 1200 V DC).

Figure C-1. A MW-Scale Single Container

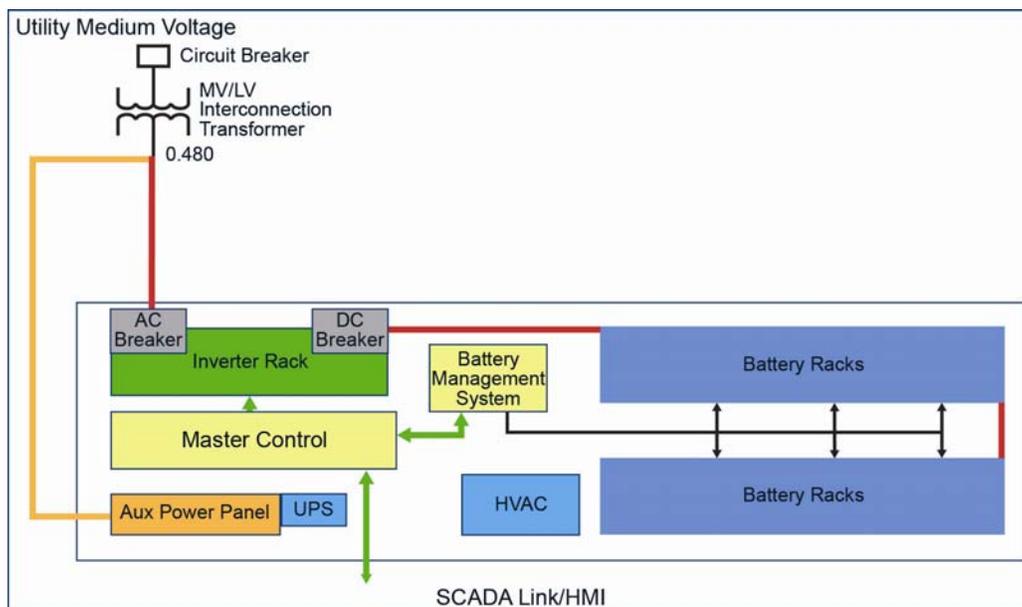

Examples of single-container designs are shown in Figure C-3. The Xtreme Power 40-foot container consists of a single 1 MWh rack of batteries installed in two sections with enclosed 1.5 MW power conversion system module. This unit has primarily been used for renewable integration, but could be applied to peak shaving as well. The A123 unit is rated at 2 MW for

power and 500 kWh for energy. The unit is suitable for power applications such as area regulation, spinning reserve and renewable integration.

Figure C 2. A MW – Scale Multiple Container

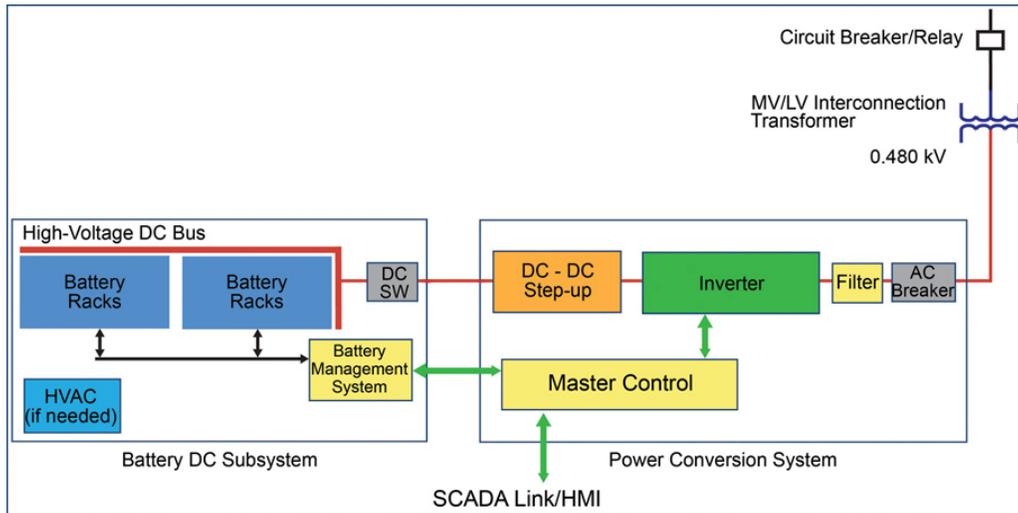


Figure C-1. Xtreme Power 1.5 MW Lead-Acid Battery System and A-123 2 MW, 500 kWh Li-Ion System




Source: Xtreme Power, Inc



An example of a multiple-container design is shown in Figure C-4. In this figure there are two NaS battery rack enclosures paired with two power conversion system enclosures. This particular system is designed for energy applications such as substation load peak shaving.

Figure C-2. A 2 MW, 7-hour NaS Battery Substation

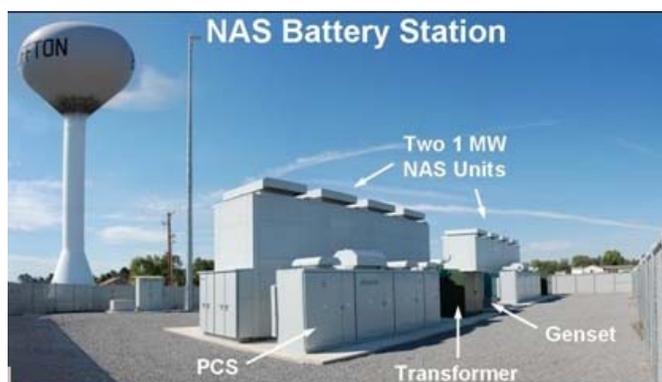

Source: American Electric Power

C.2 Battery Subsystem

The battery subsystem consists of the battery cells, electronics for monitoring and battery balancing, DC contactors/breakers and thermal management (if needed). Either cylindrical or prismatic cells are typically packaged into larger battery modules in order to build up a battery stack with the appropriate DC bus voltage and ampere-hour rating. In order to accommodate the higher voltages required for the DC bus and at the same time ensuring safety, 12 V to 60 V battery module designs are normally utilized that are easy to stack in the needed parallel-series arrangements. These 12 V to 60 V modules can either be connected directly to one another via bus bars or put into rack-mounted trays.

Examples showing how batteries can be interconnected are shown in Figure C-5. The Altairnano solution combines lithium-ion cells into modules with 8 series connected subgroups of 7 cells in parallel (8s7p). Forty-eight of these modules are combined in series to provide the appropriate DC bus voltage and 250 kWh of energy capacity. The NGK solution consists of large modules inserted in an open rack structure.

A battery management system (BMS) is used to provide a variety of monitoring, cell performance, protection, diagnostics, system integration and communications functions. The required complexity for the BMS varies depending on the battery cell technology utilized. For lead acid technology, the BMS functionality can be achieved through the use of voltage and temperature analog sensing at the rack level wired directly to a centralized monitoring system. For lithium-ion technology, electronic boards are mounted at the battery module level for measurement as well as providing battery balancing functionality. The battery management

system provides information on net battery state of charge, power limits, alarms and state of health that are utilized by the unit master control for the dispatch of the battery energy storage system.

Figure C-3. Altairnano 1 MW/250 kWh Lithium Titanate Battery Trailer and NGK NaS Battery Enclosure



Source: Altairnano



Another important subsystem is thermal management that provides for heat dissipation within the energy-storage system. Heat is generated by both the batteries and the inverter electronics. The battery mass typically keeps battery temperature from changing too rapidly during operation, but inverter temperatures change very quickly with charge/discharge current levels. If temperature is not adequately managed, then the inverters are made much more susceptible to tripping during high-power duty cycles. Overheated batteries will also tend to wear out more quickly. Thermal management varies according to the type of battery used and the range of ambient temperatures. In many cases, the thermal management could consist of a container heating, ventilation and air conditioning equipment (HVAC) with ducting to direct air flow past the batteries and critical power conversion system components. For higher power levels both the batteries and inverter could have some type of liquid-cooled system if the container HVAC is insufficient for the thermal handling requirements.

C.3 Power Conversion System

The battery-power conversion system is a critical component in an energy storage system unit. The DC-to-AC conversion is normally based on pulse-width-modulated IGBT inverter modules similar to those developed for motor-drive applications or utility high-voltage power electronic

applications. A master controller communicates the appropriate power set point to the inverter controllers, either in terms of power or current set points. Most battery manufacturers team with inverter manufacturers to provide an integrated system. Examples of this type of collaboration include A123 with Parker, Saft with ABB, and NGK with S&C Electric.


The battery racks interface to the unit inverters that tie into the utility AC system. The inverter provides a bi-directional interface between the DC battery system and AC utility system. This is done through a DC breaker that ties to a pre-charge module used to control the ramp of the inverter bus voltage during energization. Both the batteries and DC side of the inverter are typically operated as ungrounded from the container. The net inverter rating for each battery energy-storage system unit is normally obtained via the paralleling of smaller inverters. For example, a 2 MVA capacity can be achieved by paralleling six 333 kVA inverters. The inverters would need to be connected in a master to slave arrangement, with the power control coordinated via the master inverter.

The inverter AC side connects to the low-voltage utility bus via a filter that removes any harmonics generated by the inverter. Typically the low-voltage interface used for MW-scale units is 480 V three-phase. Although there is no specific standard for interconnecting energy-storage systems, the IEEE 1547 distributed generation standard has been applied in conjunction with the IEEE 519 harmonic injection standard.

C.4 System Controls

Figure C-6 shows a possible control hierarchy for a large-scale battery energy storage system. The system master controller is used to host the high-level logic and executes applications through control of the power conversion system inverter modules. The battery management system modules provide local monitoring and control at the battery rack level. However the master controller utilizes information about the state of charge and state of health of the battery racks in order to make application control decisions. The master controller also interfaces to the station equipment such as meters and relays for getting information about the grid interconnection. The master controller provides a utility SCADA interface and generally supports both a local control interface as well as remote control interface.

Figure C-4. Energy Storage System Controls

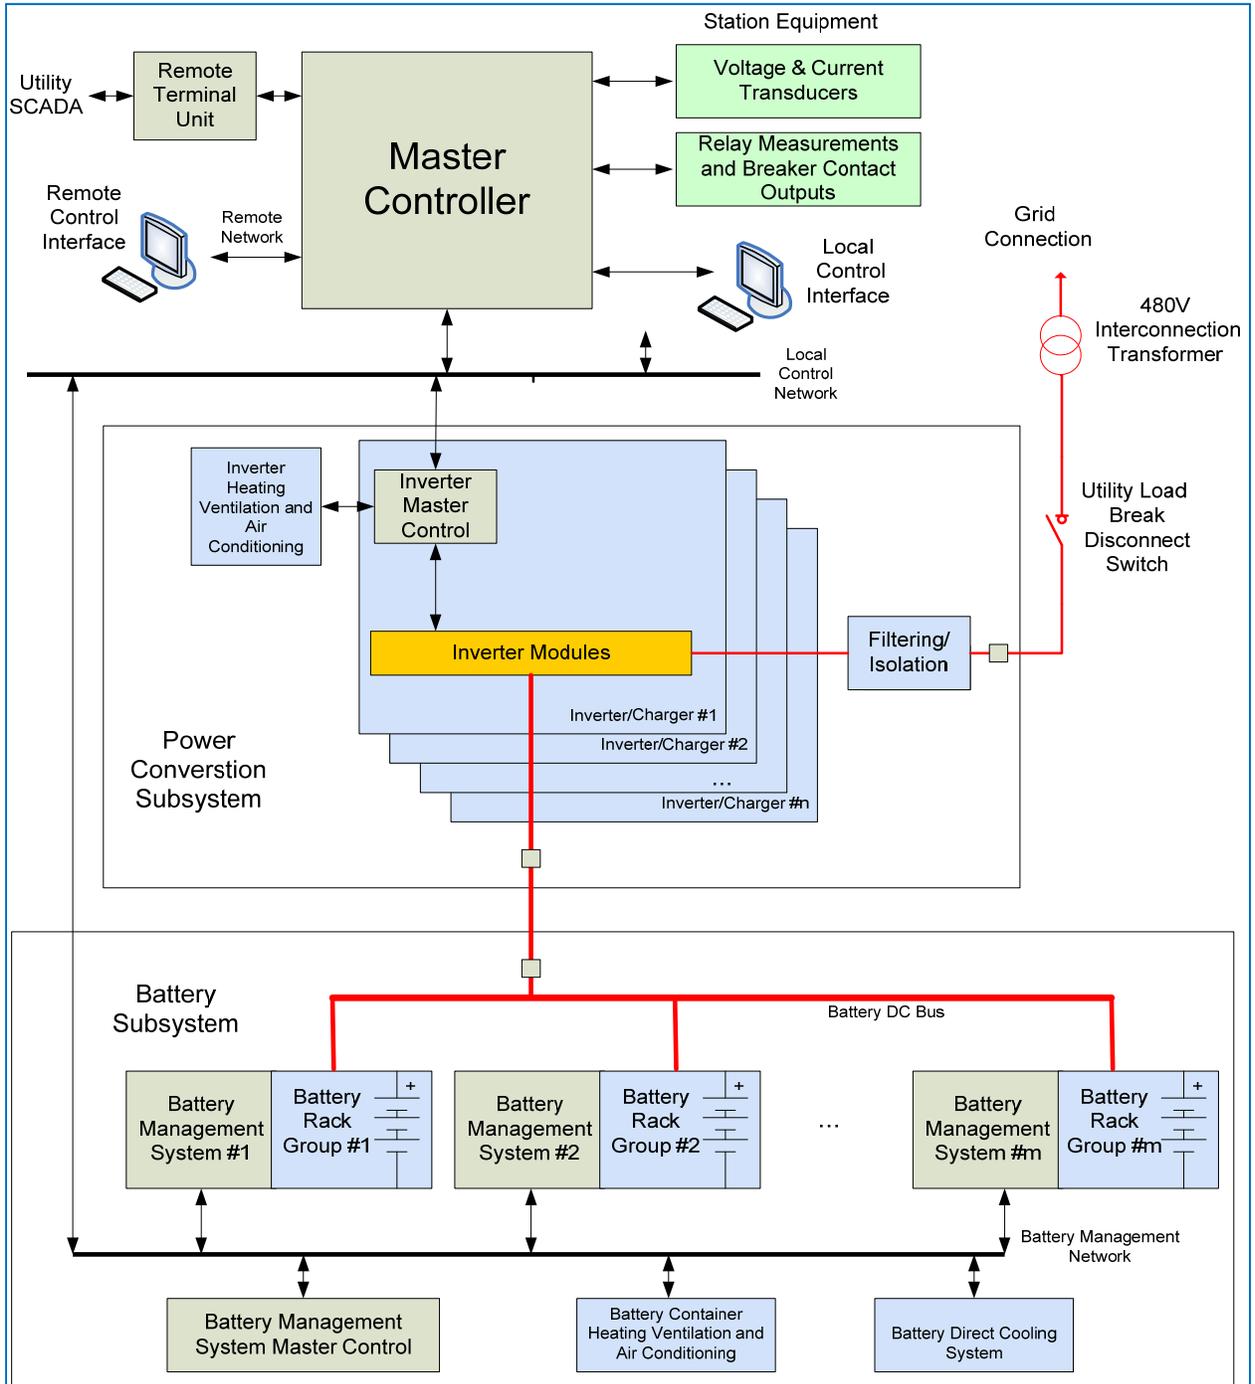

Appendix D. References

- American Electric Power.** Functional Specification for Community Energy Storage (CES) Unit, Revision 2.2. December 2009.
- . Functional Specification for Community Energy Storage (CES) Control Hub, Revision 2.1. December 2003.
- American Wind Energy Association.** Wind Power and Energy Storage. [Online] July 2009. www.awea.org.
- Bloomberg Finance,** “Grid Scale Energy Storage: State of the Market,” Bloomberg New Energy Summit, April 2011.
- Boston Consulting Group,** “Revisiting Energy Storage: There IS a Business Case,” February 2011.
- California Energy Commission.** *California Energy Demand 2010-2010 Adopted Forecast.* December 2009. CEC-200-2009-012-CMF.
- California Energy Storage Alliance,** “Energy Storage and Renewable Integration,” prepared for the 2011 IEP Annual Meeting, October 2011.
- California Independent System Operator Department of Market Monitoring.** *Market Issues & Performance 2008 Annual Report.* April 2009.
- Copper Development Association.** *Magnet Wire Market Study.* 2004.
- Database of State Incentives for Renewables & Efficiency.** RPS Policies. [Online] November 2010. www.DSIREUSA.org.
- Doughty, D.H., Butler, P.C., Akhil, A.A., Clark, N.H., Boyes, J.D.,** “Batteries for Large-Scale Stationary Electrical Energy Storage,” The Electrochemical Society Interface. Fall 2010.
- Prepared by KEMA for ESA.** *Assessment of Jobs Benefits from Storage Legislation.* March 2010.
- Electric Power Research Institute,** “Electricity Energy Storage Technology Options,” [technical update -1020676] December 2010
- Electricity Storage Association,** “Electricity Storage in the GridAn Update on Where We are Today,” [presentation, IEEE-USA Annual Meeting]. February 2009.
- Fassbinder, S.** *Transformers in Power Distribution Networks.* August 2009. Leonardo ENERGY Initiative.
- Federal Energy Regulatory Commission.** *Frequency Regulation Copensation in the Organized Wholesale Power Markets (Order 755).* 2011.
- . *Assessment of Demand Response and Advanced Metering.* September 2009.
- . *Summary 2010 Energy Market and Reliability Assessment.* May 2010. Item No A-3.

-
- Frost & Sullivan.** *The World UPS Market – Rebounding from the Economic Downturn.* June 2010. Andy Cherian Presentation.
- ISO New England Inc.** *2009 Annual Markets Report.* May 2010.
- ISO/RTO Council.** *2009 State of the Markets Report.* September 2009.
- Kundig, K.J.A.,** *The Current and Potential Future Need for Copper in Wind and Solar Renewable Electric Generating Capacity.* June 2011.
- Link D., C. Wheelock.** *Energy Storage Systems for Ancillary Services.* 2010. Pike Research.
- Masiello, R. et al.** *Research Evaluation of Wind Generation, Solar Generation, and Storage Impact on the California Grid.* June 2010.
- Monitoring Analytics.** *2010 Quarterly State of the Market Report for PJM: January through September.* 2010.
- Monitoring Analytics.** *State of the Market Report for PJM, Volume II.* March 2010.
- National Hydropower Association** website, www.hydro.org
- New York Times,** “Can Batteries Replace Power Generators?” AES Energy Storage. <http://www.aesenergystorage.com/news/ny-times-can-batteries-replace-power-generators.html>
- Piper Jaffray.** *Energy Storage – Game Changing Component of the Future Grid.* February 2009.
- PJM.** *Electricity Storage Fact Sheet.* [Online] December 2011. www.pjm.com
- PJM Resource Adequacy Planning Department.** *PJM Load Forecast Report.* January 2010.
- Pryor, L., Schlobohm, R., Brownell, B.** “A Comparison of Aluminum vs. Copper as Used in Electrical Equipment.” [Online] Viewed October 2011. www.GEIndustrial.com
- Office of Electricity Delivery and Energy Reliability, U.S. Department of Energy.** *Smart Grid Investment Grant Awards.* Viewed August 2010. Available online at: <http://www.oe.energy.gov/recovery/1249.htm>.
- U.S. Department of Energy Electricity Advisory Committee,** “Energy Storage Activities in the United States Electricity Grid,” May 2011.
- U.S. Department of Energy, Energy Information Administration,** *Annual Energy Outlook 2011.*
- U.S. Department of Energy, Energy Information Administration.** *Form EIA-411 Coordinated Bulk Power Supply Program Report.* December 2010.
- U.S. Department of Energy, Sandia National Laboratories.** *Energy Storage for the Electricity Grid: Benefits and market Potential Assessment Guide.* February 2010. SAND2010-0815.
- Venkataraman, S. et al. .** *Integration of Renewable Resources: Operational Requirements and General Fleet Capability at 20% RPS.* August 2010.

Vu, K., Masiello, R. and Fioravanti, R. *The Benefits of Fast Response Storage for Ancillary Services*. Power & Energy Society General Meeting 2009, July 2009.

Wiser, R. and Barbose, G. *State of the States: Update on RPS Policies and Progress*. November 2010. Presentation given at the State-Federal RPS Collaborative National Summit on RPS, Chicago, Illinois.